

---

---

# Verification and Validation Guidelines for High Integrity Systems

Appendices A-D

---

---

Manuscript Completed: December 1994  
Date Published: March 1995

Prepared by  
H. Hecht, M. Hecht, G. Dinsmore, S. Hecht, D. Tang

SoHaR Incorporated  
8421 Wilshire Boulevard  
Beverly Hills, CA 90211-3204

Under Contract to:  
Harris Corporation  
Information Systems  
P.O. Box 9800  
Melbourne, FL 32902

Prepared for  
Division of Systems Technology  
Office of Nuclear Regulatory Research  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555-0001  
NRC Job Code L2448

and

Nuclear Power Division  
Electric Power Research Institute  
3412 Hillview Avenue  
Palo Alto, CA 94303

**MASTER**



## **DISCLAIMER**

**This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, make any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.**

## **DISCLAIMER**

**Portions of this document may be illegible in electronic image products. Images are produced from the best available original document.**

## ABSTRACT

High integrity systems include all protective (safety and mitigation) systems for nuclear power plants, and also systems for which comparable reliability requirements exist in other fields, such as in the process industries, in air traffic control, and in patient monitoring and other medical systems. Verification aims at determining that each stage in the software development completely and correctly implements requirements that were established in a preceding phase, while validation determines that the overall performance of a computer system completely and correctly meets system requirements. Volume I of the report reviews existing classifications for high integrity systems and for the types of errors that may be encountered, and makes recommendations for verification and validation procedures, based on assumptions about the environment in which these will be conducted. The final chapter of Volume I deals with a framework for standards in this field. Volume II contains appendices dealing with specific methodologies for system classification, for dependability evaluation, and for two software tools that can automate otherwise very labor intensive verification and validation activities.



## TABLE OF CONTENTS

### APPENDIX A

|   |     |
|---|-----|
| <b>RISK BASED CLASSIFICATION GUIDELINES</b> .....                       | A-1 |
| A.1 Format for a Risk Based Classification for Protection Systems ..... | A-1 |
| A.2 Classification of Implementation .....                              | A-3 |
| A.3 System Level Severity Classification .....                          | A-5 |

### APPENDIX B

|   |     |
|---|-----|
| <b>MEASUREMENT-BASED DEPENDABILITY EVALUATION</b> ..... | B-1 |
| B.1. Introduction .....                                 | B-1 |
| B.2. Analysis of Failure Data .....                     | B-2 |
| B.3. Dependability Modeling .....                       | B-5 |
| B.4. Conclusions .....                                  | B-9 |

### APPENDIX C

|   |     |
|---|-----|
| <b>USE OF THE ECT TOOL FOR VERIFICATION</b> ..... | C-1 |
| C.1 Motivation .....                              | C-1 |
| C.2 The Feedwater Control Example .....           | C-1 |
| C.3 Process Specification .....                   | C-3 |
| C.4 Regeneration of Condition Tables .....        | C-6 |
| C.5 Conclusions .....                             | C-8 |

### APPENDIX D

|   |      |
|---|------|
| <b>THE USE OF CATS TO VERIFY EXECUTABLE CODE</b> .....    | D-1  |
| D.1 Disassembler -- DISCAT .....                          | D-1  |
| D.2 Program Analyzer -- PROCAT .....                      | D-3  |
| D.3 Control Flow Analyzer -- COCAT .....                  | D-6  |
| D.4 Data Flow Analyzer - DACAT .....                      | D-10 |
| D.5 Use of CATS for Analysis of a Real-Time Program ..... | D-14 |

## LIST OF FIGURES

|      |   |      |
|------|---|------|
| B-1  | The EAGLE 21 System Model without Software Failures         | B-6  |
| B-2  | The EAGLE 21 System Model under Software Failure Conditions | B-7  |
| C-1  | Excerpt from the RFWCS Specification                        | C-1  |
| C-2  | Condition Table for Text Formatter                          | C-6  |
| D-1  | DISCAT Metrics  | D-2  |
| D-2  | DISCAT Assembler Listing                                    | D-3  |
| D-3  | PROCAT Overview   | D-4  |
| D-4  | Calling Matrix  | D-5  |
| D-5  | COCAT Statistics  | D-5  |
| D-6  | COCAT Explanations  | D-8  |
| D-7  | Graphic Representation of Control Flow                      | D-9  |
| D-8  | Pseudocode Presentation of Control Flow                     | D-10 |
| D-9  | DACAT Statistics  | D-11 |
| D-10 | Variable Usage  | D-12 |
| D-11 | Pseudocode Assignment Analysis                              | D-13 |



## APPENDIX A

### RISK BASED CLASSIFICATION GUIDELINES

The following material is furnished as an experimental guide for the use of risk based classification for nuclear plant protection systems. As shown in Sections 2 and 3 of this report, safety classifications for the nuclear field are application based (using the function served as the primary criterion), whereas those in use by the process industry and the military are risk based. There are obvious obstacles to the use of risk based classifications (and the associated integrity levels) for nuclear power plants, yet there are also many potential benefits, including

- it considers all capabilities provided for dealing with a specific hazard, thus assigning a lower risk where multiple protection is provided (either at the same or at lower layers); this permits the plant management to perform trade-offs between systems that meet the highest qualification levels or multiple diverse systems at lower qualification levels
- it motivates the use (and therefore also the development) of protection systems with demonstrated low failure probability
- it may permit lower cost process industry equipment of an established integrity level to be used in nuclear applications (subject to verification of the integrity level and regulatory approval)

The totality of these benefits may reduce the cost of digital protection systems significantly and motivate utilities to much more rapid upgrading of the capabilities than is currently the case. Therefore the outline of a risk based classification is presented here, to serve as a starting point for further investigation and possible trial application.

#### A.1 Format for a Risk Based Classification for Protection Systems

Risk has been defined as a function of the probability of an event and the severity of its consequences. The major obstacle to the use of risk based classifications in the nuclear field is the lack of data on the frequency of occurrence of failures, particularly of software failures. This can be alleviated by using software complexity as a surrogate for frequency of failure, the assumption being that a complex program is more likely to fail than a simpler one. Therefore two methodologies are presented: the primary one based on failure frequency, and an alternate one that uses software complexity instead.

Because only rough estimates of the frequency of failure are usually available, the following frequency definitions differentiate between groups that differ by at least a factor of ten. The following levels for expected frequency of failure can be used:

- *Frequent*      Expected value greater than 0.1 incidents per plant-year
- *Probable*      Expected value less than 0.1 but greater than 0.01 incidents per plant-year
- *Occasional*    Expected value less than 0.01 but greater than 0.001 incidents per plant-year
- *Remote*        Expected value of less than 0.001 but greater than 0.00001 incidents per plant-year
- *Improbable*    Expected value less than 0.00001 incidents per plant-year

Similarly, consequences are grouped into the following four levels:

- *Extreme:* Potential for multiple deaths in general population, e. g., a condition that requires declaration of a General Emergency without remaining in conditions of lesser emergency for at least 10 minutes
- *High:* Potential for multiple deaths in plant population, e. g., a condition that requires declaration of a site area emergency without remaining in a condition of lesser emergency for at least 10 minutes
- *Moderate:* A condition that requires declaration of an alert
- *Low:* Failure can give rise to an unusual event subject to notification requirements

Table A.1, which is largely derived from the U. K. MOD 0056 standard, shows the resulting risk assignment.

**TABLE A.1. ASSIGNMENT OF RISK LEVELS**

| Failure Frequency | Severity |      |          |            |
|-------------------|----------|------|----------|------------|
|                   | Extreme  | High | Moderate | Low        |
| Frequent          | 1        | 2    | 3        | 3          |
| Probable          | 2        | 3    | 3        | 4          |
| Occasional        | 3        | 3    | 4        | 4          |
| Remote            | 3        | 4    | 4        | 4          |
| Improbable        | 3        | 4    | 4        | negligible |

If it is desired to employ software complexity as a surrogate for expected frequency of failure the following risk classification is proposed:

**TABLE A.2. MODIFIED ASSIGNMENT OF RISK LEVELS**

| Complexity | Severity |      |          |     |
|------------|----------|------|----------|-----|
|            | Extreme  | High | Moderate | Low |
| High       | 1        | 2    | 3        | 3   |
| Moderate   | 2        | 3    | 3        | 4   |
| Low        | 3        | 3    | 4        | 4   |
| Very Low   | 3        | 4    | 4        | 4   |

A noticeable change is that the five levels of expected frequency have been collapsed into four levels of complexity. This recognizes that use of a surrogate may lead to a loss of granularity; it is particularly difficult on the basis of complexity to distinguish between the bottom two levels of the frequency classification. In practice it is not believed that this difference will affect the classification significantly.

To make this classification useful for regulatory purposes guidance is provided for the assignment of consequence and frequency (or complexity) levels in Section A.3.

## A.2 Classification of Implementation

The assessment and classification of systems based on implementation involves determining the extent of redundancy and the degree of independence. These issues are discussed in sections A.2.1 and A.2.2, respectively.

### *A.2.1 Classification Based on Degree of Redundancy*

In a classification approach based upon the degree of redundancy, the analyst determines the number of failures *in the fault classes handled by the replicated system* that can be tolerated by the system prior to a degradation or cessation of service. Because redundancy is generally limited to four or fewer parallel channels, the classes into which systems are categorized in this approach can be unambiguously defined in terms of non-redundant, dual, triple, or quadruple redundancy.

"Systems" comprised of components which have varying degrees of redundancy are classified according to the components which have the least degree of redundancy. If classification by the redundancy of components yields an ambiguous result, then the system is classified by counting the least number of failures which are required to disable the system. A common problem with

this classification approach is that developers sometimes create systems which do not carry the redundancy through to a critical node, e. g., a system composed of redundant parallel functions that are evaluated in a single channel voting scheme. Considerable judgment is required to properly classify such a system.

Moreover, redundancy must be applicable to the fault classes that are a threat to the target system. For example, for the protection system the operation of fault tolerance provisions must be sufficiently prompt to prevent irreversible damage to the plant.

The degree of redundancy is an accepted indicator of the ability of the hardware components of systems to withstand multiple failures because of the implicit assumptions that failures are uncorrelated. This assumption cannot be generally substantiated for software and therefore other classifications are investigated below.

#### *A.2.2 Classification Based on Degree of Independence*

The number of successive faults to be tolerated is of much less importance in software than in hardware. Software does not undergo a physical change in connection with the failure, and therefore a failed program will continue to execute successfully as long as the data sets and computer states that led to the failure will not be repeated. But the degree of independence of back-up provisions is of primary importance because software failures are by definition due to design related faults that may also be present in alternates that have been supplied. Where the alternate is an exact copy of the failed software (e. g., a duplicate program running on another hardware platform) it is indeed certain that the fault will be present, but even under these circumstances the program may execute successfully because different data values and computer states will be encountered. For protective functions in nuclear power plants this possibility of successful execution cannot be counted on to provide a creditable back-up, and therefore the degree of independence must be evaluated.

The classification presented below is based on the following assumptions or premises:

- (i) Functional diversity provides a much greater degree of independence than software diversity for the following reasons:

The specifications for the functionally diverse approaches are necessarily different, and care should be taken to provide true independence of specifications (by having them prepared by different organizations or at least individuals, avoidance of common source documents, etc.)

The algorithms are different, provided only that dissimilar sensed data are used (and this should be an explicit requirement)

- (ii) There may be practical considerations that make it highly desirable to run the functionally diverse software on computers of the same type (each version running on a separate

multi-channel computer system). This is not considered an impairment of independence if the computers have a history of reliable operation in the proposed environment.

- (iii) Running functionally diverse software on the same set of multi-channel computers impairs independence, but the impairment can be minimized by avoidance of shared services and use of a simple proven scheduling algorithm and program which preclude the possibility of a single programming fault affecting both versions. If these steps are taken, functionally diverse programs running on the same computer are considered preferable to software diverse programs running on separate computers because the area of possible non-independence is smaller.

The following four-level classification of implementations is intended to be matched with the four-level risk classification for requirements:

- 1 - Functionally diverse programs resident on separate fault tolerant computers;
- 2 - Functionally diverse programs resident on the same fault tolerant computers<sup>1</sup>;
- 3 - Software diverse programs running on the same (or separate) fault tolerant computers<sup>1</sup>;
- 4 - Software employing fault avoidance resident on the same fault tolerant computers<sup>1</sup>;

For environments classified as having negligible risk (see Table 1) software that meets the standards of good commercial practice will be acceptable.

Where extensive use of fault avoidance is demonstrated, involving both software development process control and formal verification methods, the implementation classification is relaxed by one step (increased numerically), except for risk 1 applications.

### A.3 System Level Severity Classification

In assigning an automatic protection system or system function to the classification proposed above it must be kept in mind that the severity of the consequence is that of the automated portion (or function) alone. Thus automated protection for plant conditions which progress less rapidly can be assigned to a lower consequence category than those for plant conditions that require a rapid response. Thus, the automated initiation of engineered safety functions (ESF) is assigned a lower severity category than those for reactor trip.

---

<sup>1</sup> This means that the same two (or more) functionally diverse programs run on each of the (typically three or four) computers used for a given plant function.

A suggested general guideline (to be modified for the specific plant environment) for the severity assignment is:

Reactor trip system (sole automated trip initiation) - Extreme

Engineered safety function (sole automated function) - High

Reactor trip system (backed up) - Moderate

Functions that reduce the frequency of challenges - Moderate

All others - Low

### *A.3.1 System Level Frequency or Complexity Classification*

The use of alpha and beta factors (see Section 2.1.1) will be helpful in arriving at the appropriate frequency ranges if that option of determining risk is selected. It may be known that a software product similar to one proposed for a safety system is running as part of a control system at 15 plants in the U. S., and that among these there has been an average of one discrepancy per year reported in the past several years. All discrepancies have been of a minor nature, resulting in either the output being somewhat delayed or being just outside the specified tolerances. It is concluded that the condition probability of a catastrophic failure (given that a discrepancy is detected) is less than 0.1. Since the probability of a discrepancy being detected is less than 0.1 per year, and the probability of a catastrophic failure, given that there is a discrepancy, is also less than 0.1, it is concluded that the expected failure frequency should be assigned to the *occasional* category (between 0.001 and 0.01 per year).

When two programs are arranged side-by-side most software professionals can probably decide which is the more complex one, but an objective definition of complexity is also difficult to come by (see the report on Quality Metrics, Document H0009, generated as part of this effort). For use by a regulatory agency the complexity measure should be simple to evaluate and not be tied to a proprietary tool. The information flow metric described by Henry and Kafura meets these requirements because it is based solely on the number of incoming and outgoing signals [HENR81]. The information flow has been used to express complexity in the example discussed below, and it was found that systems could be fairly easily classified by this criterion. It is expected that the assessment of complexity will benefit in some cases by also considering the number of operating modes of the computer based system, such as calibration mode, standby mode, operating mode and maintenance mode. An investigation of the benefits that will be achieved by the additional effort required to incorporate operating modes is still incomplete.

### *A.3.2 Classification by Software Function*

Classification by software function can be used to reduce the risk level for code that does not directly affect the primary plant service. A fundamental requirement for use of reduced risk

levels is that the code associated with the lower risk function must not in any way interfere with the execution of the higher risk functions. Minimum safeguards are:

- the execution time of the lower risk functions is limited to a small fraction of the total execution time by trusted watchdog timers; in some cases, such as maintenance code, the execution of the low risk function is inhibited during normal plant operation.
- lower risk functions are prevented by a trusted mechanism from writing into the address space of the high risk functions; they may be permitted to read this address space.

An example of classification by software function is presented below.

- a. Plant Safety Function: Software involved in the generation and outputting of commands used controlling safety actuators. This is equivalent to the command function as defined by IEEE-STD-603-1990;
- b. Communication: Software involved in the transfer of data from its origination at a control function or transducer to its delivery to the user or process. Communications software works in conjunction with system and executive software in the transfer of data to and from processors;
- c. Data Acquisition: Software involved in the processing, storage, and reduction of data after arriving at its destination process;
- d. System and Executive: Software involving the operating system, vendor-supplied device drivers, low level processing to and from peripherals, and related functions;
- e. User Interface: Software involved in the presentation of data to operators and other users either interactively or in the form of fixed displays. In the case of interactive applications this classification applies to the user interface software in combination with the system software;
- f. Calibration: Software involved in setting constants and other aspects of calibration of sensors;
- g. Surveillance: Software involved in the online monitoring and diagnostics of the functional status of I&C systems.

The identification of these functions can be derived from software and system design documentation produced by the digital systems developer. In general, functions a. and b. will be at the highest risk level (the risk level set according to Section 5.1). Functions c. and d. may in some installations be at a lower risk level, e. g., where a given data acquisition function affects only a single instrument out of a multiple set, or where a given executive function has been

widely used and found to be fault free over an adequate period of time. Functions e. through g. will normally be at least one level lower in risk than a. and b. at most installations.

The classification by software function can be used at the option of the licensee or developer. A typical benefit will be that in safety systems that are classified as risk level 3 the requirement for software diversity can be relaxed for sections of the code that carry a lower risk rating than the top groups, thus lowering the cost of implementation.



## APPENDIX B

### MEASUREMENT-BASED DEPENDABILITY EVALUATION

#### B.1. Introduction

While outage frequency and down time data on nuclear plants are freely available, data on software failures in nuclear plants are usually not disseminated. Yet assumptions about software failure modes and failure rate are essential for the assessment of verification and validation methodologies and for many other decisions that affect the evaluation of software used in safety systems for nuclear power plants.

In the course of our work on the Verification and Validation Guidelines we have drawn on software failure data from other applications, such as the NASA Space Shuttle and the FAA Advanced Automation System, to make up for the lack of data from the nuclear power environment. While inferences drawn from these data are considerably better than blind guesses, it is realized that they are not conclusive because:

- the applications served by the software are different from those prevailing in safety systems (many are much more complex)
- the user environment is different (there are many more operating modes, and software experts are available on short notice when problems arise)
- they are produced by much larger software teams, using sophisticated tools and development methodologies, and frequently working in higher order languages than are currently in use for nuclear safety software.

It was therefore considered very desirable to undertake an analysis of a limited set of hardware and software failure data that became available as a result of the undertaking by the Tennessee Valley Authority (TVA) to report on failures of the Eagle 21 installation at the Sequoyah 1 and 2 plants for a period of approximately two years [TVA90][TVA91]. The analysis which is described in the body of this report is intended to demonstrate that

- fairly unstructured data (semi-annual summaries of the failures were furnished in letter form, usually describing the event and then the action taken) can be summarized to present an easily assimilated picture of the overall reliability and of trends (Tables B-1 and B-2 of this report) and by origin of the failure (Tables B-3 and B-4)
- even a relatively small quantity of data can yield meaningful confidence intervals about the expected value of the reliability parameter (particularly in Table B-1)
- tools are available to propagate reported (usually component level) failure data to

meaningful reliability and availability estimates for the multi-channel system (Section 3). The assumptions stated in that section are conservative and may overstate the system unavailability. The availability of additional data (longer period of time from these installations or from other installations) will permit use of more realistic values of key parameters.

This report is not intended to indicate concern with the dependability or safety of the Eagle 21 installations at Sequoyah. Such an assessment is outside the scope of our work, and it requires evaluation of the modes and rate of demand on the safety functions, and also equivalent failure data for other digital installations as well as for analog ones. But it appears desirable to lay a foundation for measurement based assessment of digital safety systems, and it is hoped that this report will be a step in that direction.

The measurement based approach provides a more direct (and probably more objective) evaluation of the reliability and availability of protection systems than methodologies based on product or process metrics. To exploit this promising approach it is recommended that a commitment to furnish failure data be obtained as a part of future licensing of digital installations, and that the format for such data follow that recommended in the "Error Classification Guideline" generated as part of our effort.

## B.2. Analysis of Failure Data

The analysis methods used in this section include: estimation of Mean Time Between Failures (MTBF), reliability growth analysis, and failure classification.

### **B.2.1. Overview of the EAGLE 21 System and Data**

The EAGLE 21 system is a modular, microprocessor based process protection system developed by Westinghouse Electric Corporation [WEST91]. A typical system configuration has four redundant channels which monitor plant parameters to maintain safe operation conditions and initiate the actuation of reactor trip and engineering safeguard systems on the 2-out-of-4 vote. The EAGLE 21 system consists of five physically and electrically separate subsystems: Input/Output, Loop Processor, Tester, Man-Machine Interface (MMI), and Power Supply and Distribution.

The I/O Subsystem provides interface between process sensors and the Loop Processor Subsystem (LPS), and between the LPS and control systems. The Loop Processor Subsystem performs all functions necessary to accomplish the basic protection function, such as scanning and calibration of input signals, calculations, and generation of output signals. The Tester Subsystem, in conjunction with the Man-Machine Interface cart, provides the means for testing system functions, verifying and adjusting setpoints and tuning constants, and performing automatic surveillance testing and other maintenance operations. The Power Supply and Distribution Subsystem provides separate DC power sources to different subsystems to prevent failure interaction between subsystems.

The failure data was collected from the Sequoyah Unit 1 and Unit 2 for a 2-year period. For the first half year, only Unit 1 was in operation. For the last half year, only the Unit 2 data was available. Thus, the data contains totally about 3 system years of failure reports. By a failure, we mean an abnormal or error condition detected either by the system itself or by human being. This definition may not be consistent with that proposed in [LAPR85]. Here, for the convenience of discussion, we do not distinguish between error and failure. A failure can be permanent or transient in nature, and can be caused by hardware or software problems. The severity of a failure can be divided into the component, channel, and system levels. In addition, failures can be detected during normal operation or during maintenance, which we call detection mode.

### B.2.2. Estimation of MTBF

Assume that the random variable TBF is exponentially distributed with a mean of  $M$ (MTBF). If  $n$  failures have been observed during the measurement period  $T$ , then

$$\bar{X} = \frac{T}{n} \quad (1)$$

is an estimate of  $M$ . Further, we can estimate a  $100(1-\alpha)\%$  confidence interval of  $M$ . It can be shown that  $2n\bar{X}/M$  has a chi-square distribution with  $2n$  degrees of freedom [TRIV82]. We can find two numbers,  $x^2_{\alpha/2;2n}$  and  $x^2_{1-\alpha/2;2n}$ , such that

$$P(x^2_{\alpha/2;2n} < 2n\bar{X}/M < x^2_{1-\alpha/2;2n}) = 1-\alpha \quad (2)$$

Thus, a  $100(1-\alpha)\%$  confidence interval for  $M$  is

$$\frac{2n\bar{X}}{x^2_{1-\alpha/2;2n}} < M < \frac{2n\bar{X}}{x^2_{\alpha/2;2n}} \quad (3)$$

In the following tables, for each estimated MTBF, a 90% confidence interval is provided in the adjacent parentheses.

### B.2.3. Statistics by Detection Mode

Table B-1 shows failure statistics by detection mode, i.e., the system operation mode under which the failure is detected. Most failures (70%) were detected during system maintenance and had no effects on normal operation. For the failures occurring during normal operation, none of them disabled the system safety function, although some of them created half-trip conditions. No inadvertent actuation of reactor trip was actually created under these faulty conditions because other redundant channels were functioning properly. These results indicate the important roles of regular maintenance and channel redundancy in the EAGLE 21 system.

Table B-1. Failure Statistics by Detection Mode

| Detection Mode   | Frequency | Percentage | MTBF (days)       |
|------------------|-----------|------------|-------------------|
| All              | 71        | 100        | 15.9 (13.2, 19.6) |
| Normal Operation | 21        | 29.6       | 53.8 (38.9, 80.3) |
| Maintenance      | 50        | 70.4       | 22.6 (18.2, 29.0) |

#### B.2.4. Reliability Growth Analysis

Table B-2 lists Mean Time Between Failures (MTBF) for the four subperiods in the whole data collection period. Each subperiod is approximately a half year. The calculation of the MTBF takes the average on the two measured units (systems). Included in parentheses are the 90% confidence intervals. There is no statistical difference between periods 1 and 2, and between periods 3 and 4, because the MTBF of both periods (1 and 2, or 3 and 4) falls into the other's confidence interval. However, reliability growth is obvious from the first year to the second year. This is true for both normal operation and maintenance modes.

Table B-2. MTBF by Subsystem (Half Year)

| Detection Mode   | Subperiod 1       | Subperiod 2       | Subperiod 3      | Subperiod 4      |
|------------------|-------------------|-------------------|------------------|------------------|
| All              | 11.3 (8.2, 16.7)  | 9.3 (7.2, 12.4)   | 55.4 (32.8, 118) | 38.5 (19.9, 113) |
| Normal Operation | 35.6 (21.0, 75.8) | 29.3 (19.3, 50.8) | 388 (130, 7564)  | 154 (51.4, 3002) |
| Maintenance      | 16.6 (11.4, 26.9) | 13.5 (10.1, 19.3) | 64.7 (36.9, 148) | 51.3 (24.5, 188) |

#### B.2.5. Failure Classification

Table B-3 classifies failures in terms of subsystems where they occurred. In addition to the five categories corresponding to the five subsystems in EAGLE 21, the category "other" includes events that do not fall into any of the five subsystems, such as unknown and operation failures. In the table, the percentage of failures occurring in each subsystem and the associated 90% confidence interval are provided. It is seen that nearly half failures occurred in the Tester subsystem. The number of failures occurring in the I/O, Loop Processor, and Power Supply subsystems are not statistically different, because each percentage midpoint falls into the other

two's confidence intervals.

Table B-3. Failure Distribution by Subsystem

| Subsystem  | Tester    | I/O      | Loop Processor | Power Supply | MMI     | Other   |
|------------|-----------|----------|----------------|--------------|---------|---------|
| Frequency  | 34        | 13       | 11             | 9            | 1       | 3       |
| Percentage | 47.9±11.6 | 18.3±9.0 | 15.5±8.4       | 12.7±7.7     | 1.4±2.4 | 4.2±4.7 |

Table B-4 classifies failures by type. The software MTBF is much better than the hardware MTBF. The two software specification errors involve equations for calculating the overtemperature, overpower, and comparator trip setpoints. Thus, although none of the reported software failures occurred during the normal operation of the system, they could have serious impact on the safety function.

The most significant dependability impediment is the number of processor failures. All these failures were processor lockups due to the time characteristics of the Intel 82284 clock generator and were later eliminated by replacing the Intel clock generator with a Siemens model. Multiple channel failures caused by the same fault (common mode failures), or multiple channel failures occurring coincidentally, are not found in the data.

Table B-4. Failure Statistics by Type

| Category | Type           | Frequency | Percentage | MTBF (days)          |
|----------|----------------|-----------|------------|----------------------|
| Hardware | Processor      | 37        | 88.7       | 17.9 (14.8, 22.4)    |
|          | I/O            | 10        |            |                      |
|          | Power          | 9         |            |                      |
|          | Bus            | 5         |            |                      |
|          | Memory         | 1         |            |                      |
|          | Unknown        | 1         |            |                      |
| Software | Specification  | 2         | 5.6        | 282.5 (145.7, 827.0) |
|          | Initialization | 1         |            |                      |
|          | I/O Driver     | 1         |            |                      |
| Skinware | Installation   | 2         | 5.6        | 282.5 (145.7, 827.0) |
|          | Operation      | 2         |            |                      |

### B.3. Dependability Modeling

A Markov model can be built for the EAGLE 21 system to evaluate system availability. To show the impact of hardware failures and software failures respectively, we first develop a model under only hardware failure conditions and then add software failure conditions to the model.

#### B.3.1. Availability without Software Failures

Figure B-1 shows a Markov model for the EAGLE 21 system subject to only hardware failures. The model assumes that there are four identical channels and all of them have the same failure and repair rates. Following is the notation used in the model:

- $N$  normal state in which the system is able to provide the safety function
- $C_i$  channel failure state in which  $i$  channels have failed
- $M$  maintenance state in which one channel is being maintained
- $F$  failure state in which the system is unable to provide the safety function
- $\lambda_c$  channel failure rate
- $\lambda_m$  maintenance rate
- $\mu$  channel repair rate
- $\mu_m$  reciprocal of the average maintenance time

Since the modeled system is a 2-out-of-4 system, if not at least 2 channels are available, then the system will fail. Thus, the occupancy probability of state  $F$ ,  $P_f$ , is the system unavailability, and  $1-P_f$  is the system availability.

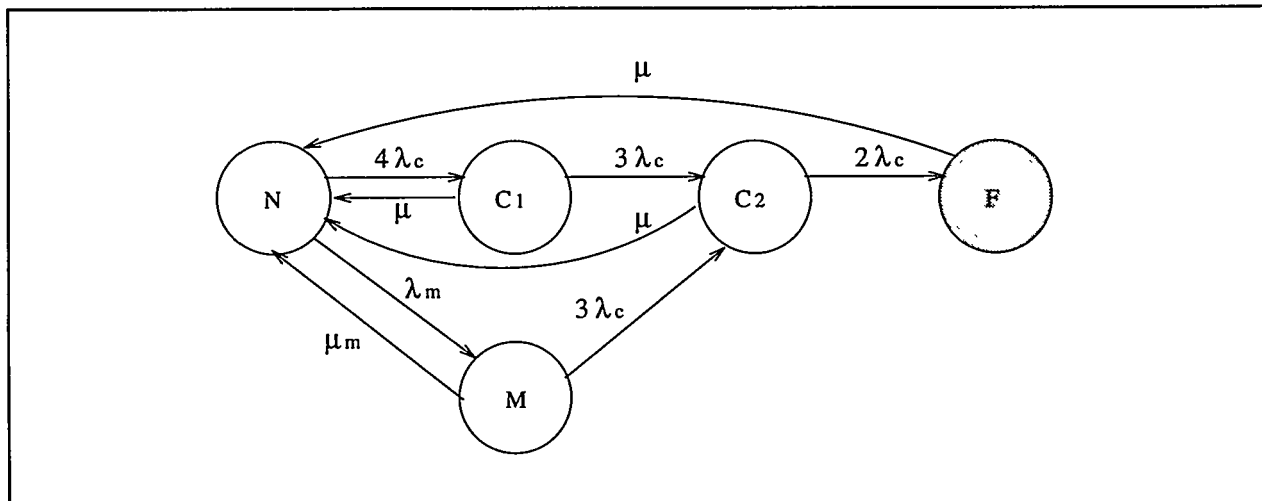


Figure B-1. The EAGLE 21 System Model without Software Failures

To estimate unavailability, the above parameters are estimated as the following values based on the data or on experience:

$$\lambda_c = 1.9 \times 10^{-4} / \text{hour (measured from the data)}$$

- $\mu = 0.5/\text{hour}$  (2 hours of repair time)
- $\lambda_m = 1.4 \times 10^{-3}/\text{hour}$  (scheduled maintenance once a month)
- $\mu_m = 0.25/\text{hour}$  (4 hours of duration for each scheduled maintenance)

By substituting these parameter values into the model and solving it using SHARPE [SAHN87], the unavailability is evaluated as  $6.33 \times 10^{-9}$ .

### B.3.2. Availability under Software Failures

Secondly, we take software failures into account. Figure B-2 shows a modified Markov model (to Figure 1) which includes software failure conditions. The model assumes that hardware failure and software failure are independent of each other. But software failures in different channels are related. If a software failure is deterministic, i.e., it does not depend on timing and system state, all channel's software may fail together. If a software failure is nondeterministic, i.e., it is timing and system state related, the software failure may occur only in one channel. Nondeterministic software failures have been found to be very significant in real-time systems [HECH93, LEE93]. Following is the additional notation used in the modified model:

- $S_i$  software failure state in which software in  $i$  channels have failed
- $\lambda_s$  failure rate of software in a channel
- $\lambda_{s2}$  failure rate of software in the second channel after the first software failure
- $\lambda_{s3}$  failure rate of software in the third channel after the second software failure

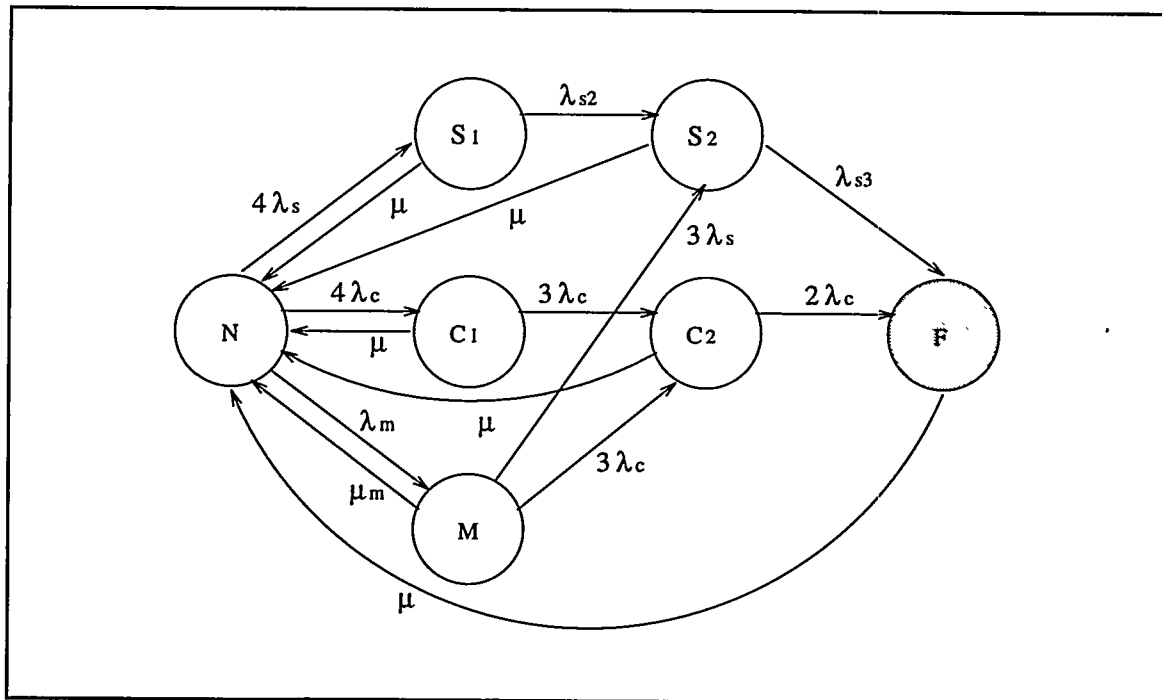


Figure B-2. The EAGLE21 System Model under Software Failure Condition

Since software failures are related,  $\lambda_{s2}$  is not simply  $3\lambda_s$  and  $\lambda_{s3}$  is not simply  $2\lambda_s$ , as we have done for hardware failures. In order to determine  $\lambda_{s2}$  and  $\lambda_{s3}$ , correlation parameters have to be introduced. A validated correlation model, called  $p$ -dependent model, has been proposed in [TANG92]. In the model, a correlation parameter,  $p_{i,i+1}$ , is defined as the probability that one more component will fail, given that  $i$  components have failed. The parameter is then used to calculate the rate from state  $i$  (with  $i$  failed components) to state  $i+1$  (with  $i+1$  failed component),  $\lambda_{i,i+1}$ , by the equation

$$\lambda_{i,i+1} = \frac{p_{i,i+1}}{1-p_{i,i+1}} \mu_{i,i-1} \quad (4)$$

where  $\mu_{i,i+1}$  is the recovery rate in state  $i$ .

In our case,  $p_{i,i+1}$  represents the probability that the  $(i+1)$ th software copy will fail given that the  $i$ th software copy has failed. Therefore,  $\lambda_{s2}$  and  $\lambda_{s3}$  can be estimated by

$$\lambda_{s(i+1)} = \frac{p_{i,i+1}}{1-p_{i,i+1}} \mu \quad (5)$$

where  $i$  equals 1 or 2, and  $\mu$  is the software recovery rate which is assumed to be the same as the channel repair rate. If we assume  $p_{12}=p_{23}=0.5$ , i.e., there is a 50% chance that another software copy will fail after each failure of a software copy, then  $\lambda_{s2}$  and  $\lambda_{s3}$  are estimated as 0.5/hour (same as  $\mu$ ).

### B.3.3. Estimation of $\lambda_s$

Because no software failure was observed during normal operation for the measured period, the average software failure rate,  $\lambda_s$ , cannot be estimated from the data. However, if we assume that the software TBF (Time Between Failure) is exponentially distributed, an upper bound of  $\lambda_s$  can be estimated from the data.

Let  $T$  denote the measured time period in which no software failure has been observed. Assume that  $\lambda_0$  is an upper bound of  $\lambda_s$ . We make hypotheses:

$$\begin{aligned} H_0: \lambda_s &\geq \lambda_0 \\ H_1: \lambda_s &< \lambda_0 \end{aligned}$$

Now we use a statistical test to reject  $H_0$  at a confidence level of  $1-\alpha$ . We know that

$$F(t) = 1 - e^{-\lambda_s t} \quad (6)$$



is the c.d.f. of the software TBF. Thus, if  $H_0$  holds, the probability that TBF is less than or equal

$$P(TTE \leq T) = F(T) \geq 1 - e^{-\lambda_0 T} \quad (7)$$

to  $T$  should satisfy

Make this probability equal to  $1 - \alpha$ :

$$1 - e^{-\lambda_0 T} = 1 - \alpha \quad (8)$$

Since we have not seen a single TBF instance within  $T$ , we should reject  $H_0$  at the confidence level of  $1 - \alpha$ , or at the significance level of  $\alpha$ . By solving the above equation, we obtain

$$\lambda_0 = \frac{-\ln \alpha}{T} \quad (9)$$

which is an upper bound of  $\lambda_s$ , although it may be too conservative.

By applying the above method to the data, an upper bound of  $\lambda_s$  is estimated as  $8.5 \times 10^{-5}$ /hour with a 90% confidence. Plugging this number into the model in Figure 2, we get a conservative estimate of the system unavailability  $1.70 \times 10^{-4}$ . Note that the estimated software failure rate ( $10^{-5}$ ) is lower than the estimated hardware failure rate ( $10^{-4}$ ). However, the system unavailability is significantly degraded by software failures. This is because there is no software fault tolerance in the modeled system.

#### B.4. Conclusions

In this paper, we demonstrated an analysis and modeling methodology in dependability evaluation for critical systems. Based on the failure data, a system dependability model was developed. The model evaluation showed:

1. The system unavailability caused by hardware failures does not exceed  $10^{-9}$ .
2. Under a conservative estimation of software failure rate, the system unavailability degrades to  $10^{-4}$ .

The estimation of software failure rate, nondeterministic software failures and the associated correlation parameters were also discussed in the paper.

## REFERENCES

- HECH93 M. Hecht, P. Crane, G. Dinsmore, and P. Thambidurai, *Analysis of CED PTRs*, Informal Technical Report, SoHaR Inc., May 1993.
- LAPR85 J.C. Laprie, "Dependable Computing and Fault Tolerance: Concepts and Terminology," *Proc. 15th Int. Symp. Fault-Tolerant Computing*, pp.2-11, June 1985.
- LEE93 I. Lee and R.K. Iyer, "Faults, Symptoms, and Software Fault Tolerance in the Tandem GUARDIAN90 Operating System," *Proc. 23rd Int. Symp. Fault-Tolerant Computing*, June 1993.
- SAHN87 R.A. Sahner and K.S. Trivedi, "Reliability Modeling Using SHARPE," *IEEE Trans. Reliability*, Vol. 36, No. 2, pp. 186-193, June 1987.
- TANG92 D. Tang and R.K. Iyer, "Analysis and Modeling of Correlated Failures in Multicomputer Systems," *IEEE Trans. Computers*, Vol. 41, No. 5, pp. 567-577, May 1992.
- TRIV82 K.S. Trivedi, *Probability and Statistics with Reliability, Queuing, and Computer Science Applications*, Prentice-Hall, Englewood Cliffs, NJ, 1982.
- TVA90 TVA letter to NRC dated May 10, 1990, "Sequoyah Nuclear Plant (SQN) - Eagle 21 Functional Upgrade Commitments", and NRC letter to TVA dated October 31, 1990, "Reactor Protection System Upgrades and Enhancements - Sequoyah Nuclear Plant, Unit 2" Accession 9005170274
- TVA91 TVA Letter to NRC dated July 10, 1991 "Sequoyah Nuclear Plant (SQN) - Unit 1 and Unit 2 - Easle 21 Six-Month Report" Accession 910715001

## APPENDIX C

### USE OF THE ECT TOOL FOR VERIFICATION

#### C.1 Motivation

The ECT (the acronym stands for Enhanced Condition Table) tool automatically extracts the implemented condition tables from source code. If the specification is in condition table format, the implemented tables and the required tables can be compared to determine exact correspondence between the specification and the implementation. The use of condition tables as a precise statement of requirements for nuclear safety software has been advocated by D. L. Parnas and is now being practiced at Ontario Hydro. The benefits of a precise statement of requirements is seen in the following example for the reactor feedwater control system (RFWCS) for a U. S. nuclear plant (the RFWCS is not a Class 1E system). Figure C.1 is a reproduction of the requirements for the water level control portion of the system; the ambiguities and inconsistencies are commented on below and it is then shown how conversion to an input/process/output (IPO) format and subsequent statement of the processes as condition tables surfaces and resolves these difficulties and gives insight into previously unrecognized modes of system operation.

#### C.2 The Feedwater Control Example

##### 4.2.1 Inputs

##### 4.2.1.1 Reactor Vessel Level

The RFWCS shall utilize the existing three narrow range level loops, L-3-53, L-3-60, and L-3-206, which will be input and validated. Any vessel level signal greater than  $\pm 5\%$  of the average shall be considered invalid. When there are only two valid signals, an alarm shall be generated for a deviation of 10% between the two valid signals. The average of the three level signals will be utilized to produce a compensated level signal for control function input and level indication. Upon loss of validation for one level signal, the average of the two remaining signals will be utilized. Upon loss of validation for two level signals, the remaining valid signal will be used. Upon loss of all valid level signals, the RFWCS shall generate an alarm and revert to manual control.

**Figure C.1 Excerpt from RFWCS Specification**

The importance of the IPO format lies in its isolation of the process. The objective of the requirements analysis part of verification is essentially to determine whether the process can

handle the inputs resulting from all foreseeable conditions. Requirements which do not clearly isolate the process make the analysis at best difficult and at worst inconclusive, as can be seen in the RFWCS specification. The process of validation is implied in the sentence "Any vessel level signal greater than  $\pm 5\%$  of the average shall be considered invalid." Incorrect or ambiguous expressions that are used in this sentence will be commented on below. For the present it is interpreted as "Any vessel signal not within  $\pm 5\%$  of the average of the narrow range signals shall be considered invalid." Now assume that the narrow range extends from 0 to 100 and that the current correct reading is 60. One of the sensors fails and reads 0, while the other two continue to read 60. The instantaneous average reading is  $120/3 = 40$ , and 5% range is 38 to 42. All signals are now invalid -- hardly the intended result.

This motivates a second interpretation which changes the key sentence to "Any vessel signal not within  $\pm 5\%$  of the average of the narrow range signals during the preceding cycle shall be considered invalid." Let the signals during the preceding cycle be 58, 60, and 62, and let the highest one fail to zero. The remaining two signals are within  $\pm 5\%$  of the average and can be validated. However, if the previous readings had been at the low end of the narrow range, say at an average of 5, a small increase in the level (e. g., to 5.3) could have simultaneously invalidated all. Any statement of tolerances purely as a percentage of the prevailing average carries with it a risk of unintended rejection at the low end of the range. It is possible that this problem may not arise due to limitations on the increase in level between computing cycles, but this will have to be investigated in further analysis.

In the first restatement of the sentence we substituted " ... not within  $\pm 5\%$  of the average ..." for the original " ... greater than  $\pm 5\%$  of the average ...". It is assumed that the original wording represented an editing oversight. If it did not, then further clarification will be required and our interpretation will have to be revised. The other correction that was made at the same time was to substitute "... average of the narrow range signals ..." for "... average ...". The reason for that substitution was to remove the possibility of using the average total water level as a criterion. If our interpretation is incorrect, the restatement of the process will of course have to be revised. But the "average" without qualification used in the original statement is obviously ambiguous and represents an obstacle to verification, regardless of the technique that is used.

Another process, this one more explicitly defined by the use of "shall" is introduced in the sentence that follows the one discussed above: "When there are only two valid signals, an alarm shall be generated for a deviation of 10% between the two valid signals." Here, again, the percentage needs to be referenced to the narrow range signals. Further, clarification is required whether the threshold is 10% of the lower or higher of the two signals, or whether it is 10% of their average. The action "... alarm shall be generated ..." can mean a specific alarm, a general alarm without further qualification, or a general alarm with a subsidiary indication of its origin.

Two additional processes are required by par. 4.2.1.1 of the specification: generation of the compensated level signal (under three different conditions of signal validation), and the generation of an alarm and reversion to manual control when all valid signals are lost. In the first of these requirements there is uncertainty about how a single valid signal shall be identified.

The preceding process required generation of an alarm when there was a significant deviation between two remaining valid signals, but no guidance is provided about how one of these can be rejected and the other one declared valid. Possibly this is an operator decision, but in any case the conditions for arriving at a single valid signal need to be identified. Similarly, the conditions for declaring a single valid signal invalid have not been identified. The alarm mentioned in the last process needs the same clarification that was discussed above.

Thus, par. 4.2.1.1 has been analyzed as containing six processes which will be identified by a dash (-) number attached to the paragraph designation. The following description of these processes are only summaries that tie them to the previous discussion. The methodology for specifying the process will be discussed later on.

- 4.2.1.1-1 The three narrow range level signals shall be validated
- 4.2.1.1-2 If there are only two valid signals, an alarm shall be generated when they differ by more than 10%
- 4.2.1.1-3 (By a process to be identified, and following the alarm) one of the two signals shall be declared valid
- 4.2.1.1-4 (By a process to be identified) the remaining valid signal may be declared invalid
- 4.2.1.1-5 A compensated level signal shall be generated as input to the control function and as level indication. The conditions for generating this signal depend on the number of valid narrow range level signals available.
- 4.2.1.1-6 If all valid signals are lost an alarm shall be generated.

The decomposition of the loosely drawn requirements of the specification into simple processes with much more explicit action requirements permits other analysis techniques to be applied. One example is Failure Modes and Effects Analysis (FMEA). The conventional starting point for hardware FMEA is a parts list, because (a) failures arise in parts, and (b) the parts list can claim to be exhaustive. Thus an FMEA based on a parts list has a solid ring to it. The equivalent of the parts list for software is the list of processes. Failures arise in processes, and the list of processes can be claimed to be exhaustive (this latter claim can not be made with respect to "functions").

### C.3 Process Specification

The definition of the -1 process identified above was "The three narrow range signals shall be validated". If the current state (as determined by validation at the previous cycle) starts with three valid signals, then validation will be based on the negative requirement developed previously: "Any vessel signal not within  $\pm 5\%$  of the average of the narrow range signals during the preceding cycle shall be considered invalid." To be valid, the signal must be within  $\pm 5\%$  of

the average of the preceding cycle. A simple mathematical notation is introduced which is defined below.

$s_n$  ( $n = 1, 2, 3$ ): current cycle narrow range sensor signals

$S_n$  ( $n = 1, 2, 3$ ): current cycle validated sensor signals

$S'_n$  ( $n = 1, 2, 3$ ): previous cycle validated sensor signals

$S'' \equiv (S'_1 + S'_2 + S'_3)/3$  (average previous cycle signal)

For three previous cycle valid signals the conditions for current cycle valid signals can then be defined as

$$S_n = \begin{cases} s_n & \text{for } .95 S'' \leq s_n \leq 1.05 S'' \\ \emptyset & \text{otherwise (a member of the null set)} \end{cases}$$

These relations are in more detail expressed in the following condition table. In the upper part of the table the first column lists the conditions applicable to a row, and the entries in the other columns indicate whether the condition is true (y) or false (n). In this format the columns are also referred to as *rules*. The lower half of the table lists the action (assignments) that are desired for the rule in that column.

Table C-1. Conditions for Three Previously Validated Signals

|                                |           |                 |                 |                 |                 |                 |                 |                 |
|--------------------------------|-----------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|
| $.95S'' \leq s_1 \leq 1.05S''$ | y         | n               | y               | y               | y               | n               | n               | n               |
| $.95S'' \leq s_2 \leq 1.05S''$ | y         | y               | n               | y               | n               | y               | n               | n               |
| $.95S'' \leq s_3 \leq 1.05S''$ | y         | y               | y               | n               | n               | n               | y               | n               |
|                                | $S_1=s_1$ | $S_1=\emptyset$ | $S_1=s_1$       | $S_1=s_1$       | $S_1=s_1$       | $S_1=\emptyset$ | $S_1=\emptyset$ | $S_1=\emptyset$ |
|                                | $S_2=s_2$ | $S_2=s_2$       | $S_2=\emptyset$ | $S_2=s_2$       | $S_2=\emptyset$ | $S_2=s_2$       | $S_2=\emptyset$ | $S_2=\emptyset$ |
|                                | $S_3=s_3$ | $S_3=s_3$       | $S_3=s_3$       | $S_3=\emptyset$ | $S_3=\emptyset$ | $S_3=\emptyset$ | $S_3=s_3$       | $S_3=\emptyset$ |

The table reveals that it is possible to transition from the normal (three valid signals) state to a state with only a single valid signal or possibly even to one with no valid signals. This, by itself, is a significant result of the use of this methodology. The table also provides a starting point for a very intensive test approach that is useful for validation but is outside the scope of the present discussion.

For only two valid signals during the preceding cycle, designated  $S'_m$  ( $m = a, b$ ), and the assumption that the 10% criterion applies to the average of the two signals, we define

$$S' \equiv (S'a + S'b)/2$$

$$S_m = \begin{cases} sm & \text{for } |sa - sb| \leq 0.1 S' \\ \emptyset & \text{otherwise} \end{cases}$$

The condition table for this case is shown below. The following combinations are considered physically impossible and have been omitted: the difference between the signals is within the threshold, but each signal deviates by more than 5% from  $S'$ ; and the difference between the signals is outside the threshold, and both signals deviate by less than 5% from  $S'$ .

Table C.2 Conditions for Two Previously Validated Signals

|                         |       |       |       |       |       |      |
|-------------------------|-------|-------|-------|-------|-------|------|
| $ sa - sb  \leq 0.1S'$  | y     | y     | y     | n     | n     | n    |
| $ S' - sa  \leq 0.05S'$ | y     | n     | y     | y     | n     | n    |
| $ S' - sb  \leq 0.05S'$ | y     | y     | n     | n     | y     | n    |
|                         | Sa=sa | Sa=sa | Sa=sa | Sa=sa | Sa=∅  | Sa=∅ |
|                         | Sb=sb | Sb=sb | Sb=sb | Sb=∅  | Sb=sb | Sb=∅ |

Here, again, considerable insight is gained through use of condition tables, e. g., in the third through fifth column of the table. The results shown in the bottom two rows may not be those anticipated by the user; if changes in the process are desired, the table provides an excellent medium for specifying them in a precise and complete manner.

For only a single valid signal during the preceding cycle, designated  $S'k$ , and the assumption that validation requires it to be within 5% of its previous value,

$$S_k = \begin{cases} sk & \text{for } |S'k - sk| \leq 0.05 S'k \\ \emptyset & \text{otherwise} \end{cases}$$

The condition table for this case becomes simply

Table C.3 Conditions for One Previously Validated Signal

|                            |         |        |
|----------------------------|---------|--------|
| $ S'k - sk  \leq 0.05 S'k$ | y       | n      |
|                            | Sk = sk | Sk = ∅ |

Similar condition tables will be developed for every safety critical process.

## C.4 Regeneration of Condition Tables

The work described in this subheading utilizes the ECT (enhanced condition table) tool that has been developed by SoHaR under contracts from NASA and the U. S. Navy [HECH90]. ECT was primarily developed to improve test coverage, and these capabilities will be utilized in the test methodology described in the following subheading. A substantial benefit for verification is that ECT generates the condition tables that are implemented in the code. These can then be compared with the tables that define the process, *thereby verifying that the design and coding correctly implement the requirements*, and greatly reducing the concern with the contractor's software development environment.

An example of a C program and the condition table automatically generated from it by ECT are shown in the following figure. The program is a translation into C of a simple text formatter described in the Goodenough and Gerhart paper that proposed the use of condition tables for test data selection [GOOD75]. In this program the exclamation mark (!) indicates negation, and a double vertical bar (|) denotes the inclusive OR. The rows and columns are interchanged from the conventional presentation used in the reference and in the preceding subheading to facilitate printing where many rules need to be evaluated. Also, some additional symbols are introduced: the dash (-) indicates a "don't care" condition (the output is not affected by the state of this condition), and (y) and (n) are used to denote conditions necessarily imposed by a preceding condition. As an example of the latter notation, consider conditions c1 and c2. If the current input character is a BL (blank line) it cannot at the same time be an ET (end of text code). Therefore the first four entries in the c2 column are (n).

| <pre> main() {   Alarm = false;   bufpos = 0;   fill = 0;   do {     incharacter (&amp;CW);     if (CW == BL    CW == ET) {       if (bufpos != 0) {         if (fill + bufpos &lt; MAXPOS &amp;&amp; fill != 0) {           outcharacter (BL);           fill = fill + 1;         } else {           outcharacter(NL);           fill = 0;         }       }       for (k = 1; k&lt;= bufpos; k++)         outcharacter(buffer[k]);       fill = fill + bufpos;       bufpos = 0;     } else {       if (bufpos == MAXPOS)         Alarm = true;       else {         bufpos = bufpos + 1;         buffer[bufpos] = CW;       }     }   } while (!(Alarm    CW == ET)); } </pre> | <p>Condition Table (w/semantics knowledge) for function "main"</p> <p>c1: CW==BL<br/> c2: CW==ET<br/> c3: bufpos!=0<br/> c4: fill+bufpos&lt;MAXPOS<br/> c5: fill!=0<br/> c6: bufpos&lt;MAXPOS</p> <table border="1"> <thead> <tr> <th></th> <th>c1</th> <th>c2</th> <th>c3</th> <th>c4</th> <th>c5</th> <th>c6</th> </tr> </thead> <tbody> <tr> <td>y</td> <td>(n)</td> <td>y</td> <td>y</td> <td>y</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>y</td> <td>(n)</td> <td>y</td> <td>y</td> <td>n</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>y</td> <td>(n)</td> <td>y</td> <td>n</td> <td>-</td> <td>-</td> <td>-</td> </tr> <tr> <td>y</td> <td>(n)</td> <td>n</td> <td>-</td> <td>-</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>y</td> <td>y</td> <td>y</td> <td>y</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>y</td> <td>y</td> <td>y</td> <td>n</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>y</td> <td>y</td> <td>n</td> <td>-</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>y</td> <td>n</td> <td>-</td> <td>-</td> <td>(n)</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>n</td> <td>(y)</td> <td>(n)</td> <td>-</td> <td>y</td> <td>(n)</td> </tr> <tr> <td>n</td> <td>n</td> <td>-</td> <td>-</td> <td>-</td> <td>n</td> <td>(n)</td> </tr> </tbody> </table> |     | c1  | c2 | c3  | c4  | c5 | c6 | y | (n) | y | y | y | (n) | (n) | y | (n) | y | y | n | (n) | (n) | y | (n) | y | n | - | - | - | y | (n) | n | - | - | (n) | (n) | n | y | y | y | y | (n) | (n) | n | y | y | y | n | (n) | (n) | n | y | y | n | - | (n) | (n) | n | y | n | - | - | (n) | (n) | n | n | (y) | (n) | - | y | (n) | n | n | - | - | - | n | (n) |
|---|--|-----|-----|----|-----|-----|----|----|---|-----|---|---|---|-----|-----|---|-----|---|---|---|-----|-----|---|-----|---|---|---|---|---|---|-----|---|---|---|-----|-----|---|---|---|---|---|-----|-----|---|---|---|---|---|-----|-----|---|---|---|---|---|-----|-----|---|---|---|---|---|-----|-----|---|---|-----|-----|---|---|-----|---|---|---|---|---|---|-----|
|   | c1   | c2  | c3  | c4 | c5  | c6  |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| y   | (n)  | y   | y   | y  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| y   | (n)  | y   | y   | n  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| y   | (n)  | y   | n   | -  | -   | -   |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| y   | (n)  | n   | -   | -  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | y  | y   | y   | y  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | y  | y   | y   | n  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | y  | y   | n   | -  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | y  | n   | -   | -  | (n) | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | n  | (y) | (n) | -  | y   | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |
| n   | n  | -   | -   | -  | n   | (n) |    |    |   |     |   |   |   |     |     |   |     |   |   |   |     |     |   |     |   |   |   |   |   |   |     |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |   |   |   |     |     |   |   |     |     |   |   |     |   |   |   |   |   |   |     |

Figure 4 Condition table for text formatter



The condition table generated from the code exactly duplicates the one developed in the paper from the statement of the problem; the action listing (corresponding to the lower part of the tables shown in the preceding subheading) is suppressed in the figure. The recognition of conditions that necessarily result from preceding conditions is accomplished by the semantic analysis portion (SEM) of the ECT program. SEM generally identifies infeasible rules and thereby reduces both the volume of the condition tables and the amount of test cases that have to be investigated. An example of a semantically infeasible rule is represented by the following hypothetical timesheet program:

```
IF day_of_week = Sunday
    start new timesheet
Enter daily hours
...
IF day_of_week = Saturday
    total hours for week
```

Since the day of the week cannot be both Sunday and Saturday these conditions will never have to be evaluated together, and it should not be attempted to construct a test case in which both IF statements are true.

The ECT program currently operates on Ada and C programs. If a BNF (Normal Form) grammar exists for other languages used in the control system, then a parser can be for the ECT can be created by inputting the logic into the *yacc* UNIX-based software tool. For other languages (e.g., ladder logic and many assembly languages), the recreation of the condition tables can be performed manually, aided by static analysis tools, as is the current practice at Ontario Hydro.

The condition tables generated by ECT are compared with those produced as part of the process specification. In many cases there will be an exact match, indicating that the requirements have been correctly implemented in the design and coded into the program. In other cases differences may be noted, and these may be due to:

- redesignation of program variables (in particular to designate temporary assignments)
- re-ordering of predicate evaluation for programming efficiency
- undocumented communications between specifiers and designers, or between designers and programmers
- artifacts due to programming style
- misinterpretations of the requirements or the design.

The first two of these causes are to be expected. The other three are undesirable but do not necessarily result in an unacceptable program. In the review of the original CANDU/OH shut-down program most of the discrepancies of this type had at worst an insignificant effect on program operation. But as part of verification all of them will need to be investigated and documented, and comparison of the condition tables is a very efficient way of accomplishing this.

### C.5 Conclusions

The use of ECT has the potential of overcoming many difficulties currently encountered in the verification and validation of high integrity systems. Some of these were pointed out in the body of this report:

- it targets differences between requirements and code, and hence is effective in detecting both unimplemented requirements and unintended functions (functions that do not implement requirements)
- most steps in the procedures required for its use in V&V can be automated, and hence the cost can be bounded
- it is an inherently independent activity, regardless of who performs it
- it does not require access to the developers design or development process, and it is therefore applicable to commercial and proprietary software

It is also effective in identifying abnormal conditions and events (ACEs) that can interfere with the normal execution of the code. An example of this is the simultaneous failure of two sensors for which no action was not specified in the textual requirements but for which appropriate handling was indicated in the condition table statement of the requirements (Table C-1).

Because of the large potential pay=off, further research in this technique is recommended.

### **REFERENCES**

- GOOD75 J.B. Goodenough and S.L. Gerhart, "Toward a Theory of Test Data Selection", *IEEE Transactions on Software Engineering*, Vol. SE-1, No.2, pp.156-173, June 1975
- HECH90 M. Hecht, K. Tso, and S. Hochhauser, "Enhanced Condition Tables for Verification of Critical Software", *Proc. 7th International Conference on Software Testing*, San Francisco, June 1990.

## APPENDIX D

### THE USE OF CATS TO VERIFY EXECUTABLE CODE

The Code Analyzer Tool Set, CATS, was developed by Technischer Überwachungs Verein (TÜV) Norddeutschland for the purpose of analyzing (and subsequently certifying) embedded controllers for small microprocessor systems. TÜV is a quasi-governmental organization for certifying the safety and suitability of technology related products. The organization's name can be loosely translated as "Institute for Technical Protection". The tool set is intended to provide a detailed understanding of all operationally significant attributes of a program, typically one that is furnished for certification on a ROM (read-only memory) chip.

The major components of CATS are

- a disassembler -- DISCAT
- a program analyzer -- PROCAT
- a control flow analyzer -- COCAT
- a data flow analyzer -- DACAT

The functions and benefit for verification of each of these tools is presented below. A real-time routine developed at SoHaR was submitted for analysis by CATS, and the results of this are discussed in the last section of this appendix.

#### D.1 Disassembler -- DISCAT

Disassembly is the process of reconstructing assembly level code from machine code (executable code). The disassembly by DISCAT is path related, while in most other disassemblers it is governed by the memory structure. In path related disassembly the assembler level code will be generated in the order in which it is likely to be executed. In disassembly by memory structure the assembler code is generated in the order in which it is loaded in memory, which frequently means that code will be interspersed with data, and that the analyst will have to reconstruct jumps and calls.

The primary outputs of DISCAT are:

- a metrics file, providing overall program statistics (Fig. D.1)
- assembly level code (Fig. D.2)

- lists of exceptions and memory address ranges that were not disassembled (because they contained data or other non-code information)
- data files that are input to other CATS programs.

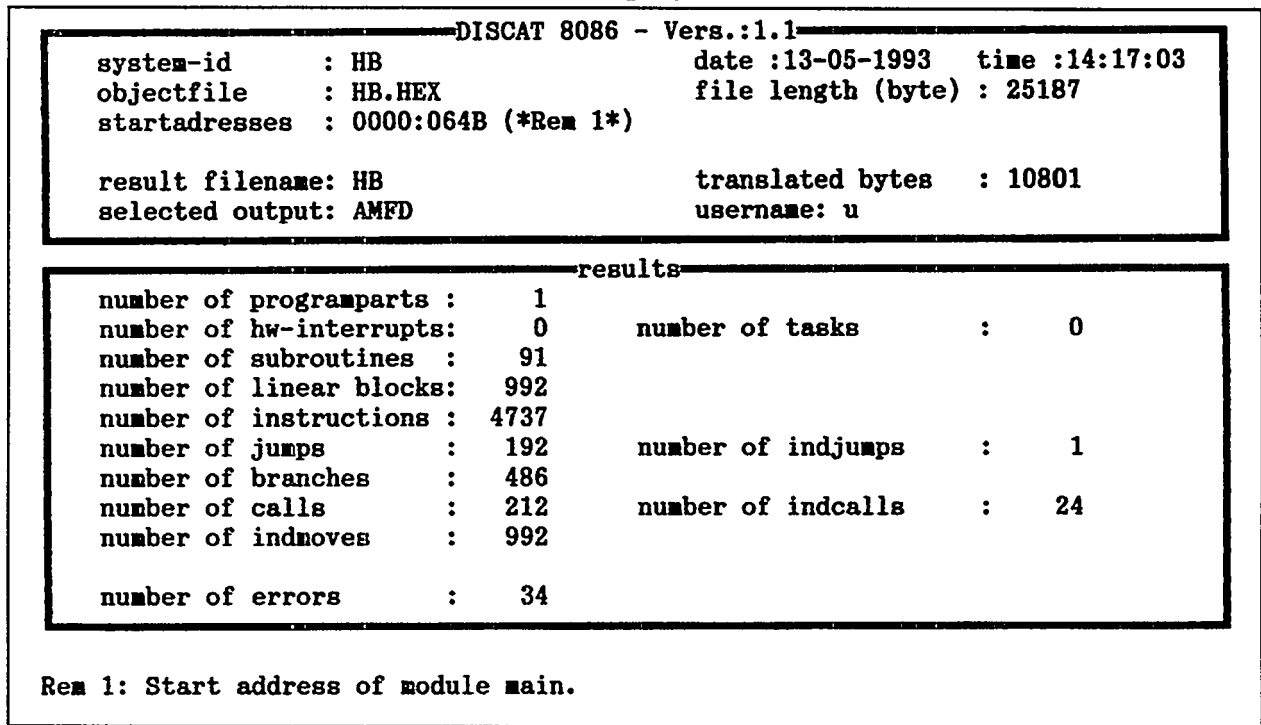


Figure D.1 DISCAT Metrics

The metrics file can be used for verifying that the input file (or the ROM chip) did not contain extraneous material, and whether the machine code contained unusual constructs that might give problems in execution. The example shown in Figure D.1 lists 34 errors (more appropriately: exceptions) most of which were due to the use of an indirect address mode that is permissible in the processor used for this code but was not in the processor model used by CATS. Flagging of these exceptions is valuable when applications in a broader environment are anticipated.

A sample of the assembly level code generated by DISCAT is shown in D.2. The top part of the figure is a diagram of the overall routine structure, while the bottom part is a listing of the assembly instructions in the order in which they are expected to be encountered. If the compiler generates an assembly output, it can be directly compared with the disassembled code. In other cases the program structure of the source code can be compared with that generated in disassembly.

\*\*\*\*\*  
DISCAT51 - Vers.:1.2a date:25-09-1992 time:14:00:54

DEMO.ASM

page: 0

\*\*\*\*\*

program list  
-----

| label    | adr  | instruction       |
|----------|------|-------------------|
| :.....   |      |                   |
| prog0000 | 0000 | ljmp 0036         |
| :.....   |      |                   |
| inte0003 | 0003 | ljmp 0003         |
| :.....   |      |                   |
| inte000B | 000B | ljmp 000B         |
| :.....   |      |                   |
| inte0013 | 0013 | ljmp 0013         |
| :.....   |      |                   |
| inte001B | 001B | ljmp 001B         |
| :.....   |      |                   |
| inte0023 | 0023 | ljmp 0023         |
|          |      |                   |
| jump0036 | 0036 | ani r090,#F0      |
|          | 0039 | setb bB3          |
|          | 003E | setb bB2          |
|          | 003D | setb bB5          |
|          | 003F | mov r00,#08       |
|          | 0041 | mov r02,#78       |
|          | 0043 | clr rE0           |
|          |      |                   |
| jump0044 | 0044 | mov (r00),rE0     |
|          | 0045 | inc r00           |
|          | 0046 | djnz r02,0044     |
|          |      |                   |
| next0048 | 0048 | mov r22,#2C       |
|          | 004B | mov r02,#00       |
|          | 004D | mov dptr,#8000    |
|          | 0050 | clr rE0           |
|          | 0051 | ljmp 0056         |
|          |      |                   |
| jump0054 | 0054 | inc r02           |
|          | 0055 | inc dptr          |
|          |      |                   |
| jump0056 | 0056 | movx [dptr],rE0   |
|          | 0057 | cjne r02,#FF,0054 |

Figure D.2 DISCAT Assembler Listing

## D.2 Program Analyzer -- PROCAT

PROCAT is the program analyzer constituent of CATS. Its main purpose is to assist in top level analysis of program execution. The primary outputs are:

- an overview table (Figure D.3)
- a calling matrix (Figure D.4)
- a hierarchy file

The following pictures show output examples for some of the result files mentioned above.

### overview table:

| routine overview |                        |   |        |                               |                                 |   |                                     |                                       |               |           |
|------------------|------------------------|---|--------|-------------------------------|---------------------------------|---|-------------------------------------|---------------------------------------|---------------|-----------|
| routine typ      | address of entry block | address of lowest routine block if it is lower than entry block |        | address of last routine block | number of blocks in the routine | number of exits if different from one codesharing with other routines | number of direct called subroutines | number of indirect called subroutines | nesting depth | recursion |
| RTyp             | EntryBl                | FirstBl   | LastBl | BlockNb                       | ExitNb                          | CShar.  | DSR                                 | OSR                                   | Nest          | Rec       |
| Prog             | 000000                 |   | 000095 | 8                             | NoExit                          |   | 18                                  | 24                                    | 4             |           |
| Int              | 000003                 |   | 000003 | 1                             | NoExit                          |   |                                     |                                       |               |           |
| Int              | 00000B                 |   | 00000B | 1                             | NoExit                          |   |                                     |                                       |               |           |
| Int              | 000013                 |   | 000013 | 1                             | NoExit                          |   |                                     |                                       |               |           |
| Int              | 00001B                 |   | 00001B | 1                             | NoExit                          |   |                                     |                                       |               |           |
| Int              | 000023                 |   | 000023 | 1                             | NoExit                          |   |                                     |                                       |               |           |
| Prog             | 000143                 |   | 000146 | 2                             |                                 |   |                                     |                                       |               |           |
| Subr             | 000159                 |   | 000159 | 1                             |                                 |   | 2                                   | 2                                     | 2             |           |
| Subr             | 00016C                 |   | 00017F | 3                             |                                 |   | 2                                   |                                       | 1             |           |
| Subr             | 000180                 |   | 0001B2 | 8                             | 3                               |   | 2                                   |                                       | 1             |           |
| Subr             | 0001B5                 |   | 00021F | 6                             |                                 |   | 2                                   |                                       | 1             |           |
| Subr             | 000233                 |   | 000233 | 1                             |                                 |   | 2                                   |                                       | 1             |           |

Figure D.3 PROCAT Overview



indicates possible deviations from required code attributes in number of exits, code sharing, use of indirect calls, and recursion. The significance to verification depends on (a) the coding standards that are invoked, and (b) the weight given in the assessment to procedural vs. functional deviations. In the example code submitted by SoHaR a number of library routines (supplied with the compiler) used recursion. The standard to which the code was developed discourages recursion. The identification of this feature is considered desirable (as a caution notice), but it did not cause abandonment of the library routines. The calling matrix provides valuable insights into the calling structure and the types of calls that are made. Some compilers provide a similar matrix at the source code level that can be compared with that generated from the machine code. The hierarchy file is another useful tool for analyzing top level program flow, and can usually be compared with an equivalent hierarchy file generated from the source.

### D.3 Control Flow Analyzer -- COCAT

COCAT analyzes the detailed control flow within program segments. Its main purpose is to identify structural weaknesses in the code, such as high levels of nesting, heavy dependence of backward jumps, unstructured jumps, and improper exits. Even when they are by themselves tolerable, the presence of deviations from good coding practice may indicate a need to revise the code. The presence of more than a few deviations in a program indicates at the very least that it may be very difficult to maintain.

The key outputs of COCAT are:

- Control flow statistics (Figure D.5)
- Comment sheet on exceptions from structured control flow (Figure D.6)
- Graphic presentation of control flow (Figure D.7)
- Pseudocode presentation of control flow (Figure D.8)



## Examples from CoCAT protocoll (File \*.PRC)

| Number of Routine | Name        | Kind | Startaddress | Number of Blocks |           |          | Nesting depth of forward jumps |            | Nesting depth of backward jumps |          | Nesting depth of structures |         | Number of jumps |  | Structure violation |  | No of weaknesses |  | Runtime [cycl.] |  |
|-------------------|-------------|------|--------------|------------------|-----------|----------|--------------------------------|------------|---------------------------------|----------|-----------------------------|---------|-----------------|--|---------------------|--|------------------|--|-----------------|--|
|                   |             |      |              |                  |           |          |                                |            |                                 |          |                             |         |                 |  |                     |  |                  |  |                 |  |
| 1                 | Main        | p    | 0000         | 138              | 6         | 4        | 8                              | 108        | 41                              | 1        | 619                         | >999999 |                 |  |                     |  |                  |  |                 |  |
| 2                 | IR 0        | i    | 0003         | 40               | 10        | 0        | 11                             | 34         | 15                              | 0        | 160                         | 20      |                 |  |                     |  |                  |  |                 |  |
| 3                 | Timer 0     | i    | 000B         | 21               | 5         | 0        | 6                              | 17         | 2                               | 2        | 124                         | 13      |                 |  |                     |  |                  |  |                 |  |
| 4                 | IR 1        | i    | 0013         | 13               | 5         | 0        | 6                              | 11         | 2                               | 0        | 65                          | 6       |                 |  |                     |  |                  |  |                 |  |
| 5                 | Timer 1     | i    | 001B         | 1                | 0         | 0        | 1                              | 0          | 0                               | 1        | 2                           | 1       |                 |  |                     |  |                  |  |                 |  |
| 6                 | Serial Port | i    | 0023         | 1                | 0         | 0        | 1                              | 0          | 0                               | 1        | 2                           | 1       |                 |  |                     |  |                  |  |                 |  |
| 7                 | zu Main     | s    | 0800         | 5                | 0         | 1        | 2                              | 2          | 0                               | 0        | 72                          | 4       |                 |  |                     |  |                  |  |                 |  |
| 8                 | zu 0800     | s    | 0859         | 3                | 0         | 1        | 2                              | 1          | 0                               | 0        | 5                           | 2       |                 |  |                     |  |                  |  |                 |  |
| 9                 | zu 0800     | s    | 085E         | 3                | 0         | 1        | 2                              | 1          | 0                               | 0        | 5                           | 2       |                 |  |                     |  |                  |  |                 |  |
| 10                | zu Main     | s    | 0870         | 8                | 2         | 1        | 4                              | 5          | 1                               | 0        | 38                          | 7       |                 |  |                     |  |                  |  |                 |  |
| 11                | zu Main     | s    | 08B0         | 30               | 6         | 1        | 7                              | 25         | 14                              | 0        | 127                         | 62      |                 |  |                     |  |                  |  |                 |  |
| 12                | zu Main     | s    | 08C0         | 30               | 6         | 1        | 7                              | 24         | 14                              | 0        | 125                         | 62      |                 |  |                     |  |                  |  |                 |  |
| 13                | zu 0870     | s    | 09B0         | 3                | 0         | 1        | 2                              | 1          | 0                               | 0        | 13                          | 2       |                 |  |                     |  |                  |  |                 |  |
| 14                | zu 0870     | s    | 09B2         | 2                | 0         | 1        | 2                              | 1          | 0                               | 0        | 12                          | 2       |                 |  |                     |  |                  |  |                 |  |
| 15                | zu 08B0     | s    | 09D0         | 3                | 0         | 1        | 2                              | 1          | 0                               | 0        | 13                          | 2       |                 |  |                     |  |                  |  |                 |  |
| 16                | zu 08B0     | s    | 09D2         | 2                | 0         | 1        | 2                              | 1          | 0                               | 0        | 12                          | 2       |                 |  |                     |  |                  |  |                 |  |
| 17                | zu Main     | s    | 0A00         | 19               | 3         | 1        | 4                              | 12         | 2                               | 3        | 71                          | 104     |                 |  |                     |  |                  |  |                 |  |
| 18                | zu Main     | s    | 0A70         | 10               | 1         | 5        | 6                              | 7          | 0                               | 3        | 38                          | >999999 |                 |  |                     |  |                  |  |                 |  |
| <b>Total</b>      |             |      |              | <b>332</b>       | <b>10</b> | <b>5</b> | <b>11</b>                      | <b>251</b> | <b>91</b>                       | <b>1</b> |                             |         |                 |  |                     |  |                  |  |                 |  |

## Overview of Controlflow Properties

- 0023 : interrupt routine consists of a RETURN only
- 024C : unconditional jump over 20 Byte to next block
- 0A5A : infinite loop consisting of 1 Block only
- 0A5A : routine ends with a jump instead of a RETURN
- 0A9A : routine does not begin at first block
- 0C09 : RETURN before end of Routine
- 0CA5 : unconditional jump to next statement

## Hints on Controlflow Peculiarities

Figure D.5 COCAT Statistics

| Nr    | Address + Name / Text / Comment                    | o.k.   |   |
|-------|--|--------|---|
|       |  | y      | n |
| 6     | 0A9A IR 0<br>routine does not begin at first block |        |   |
| 7     | 0C09 IR 0<br>RETURN before end of Routine          |        |   |
| 8     | 0CA5 IR 0<br>unconditional jump to next statement  |        |   |
| Date: |  | Name : |   |

**Comment Sheets for Hints on Controlflow Peculiarities**

Figure D.6 COCAT Explanations

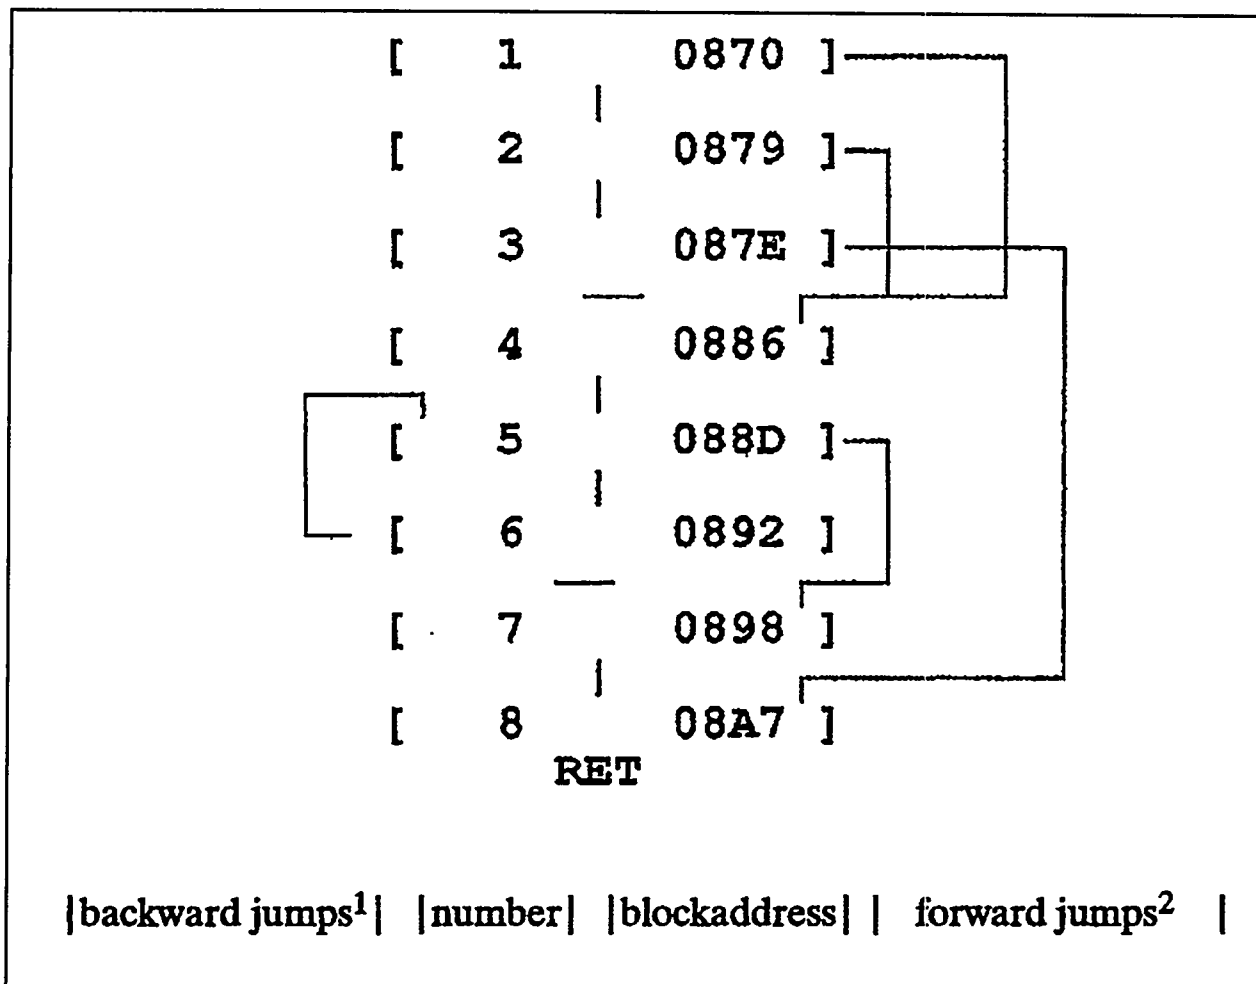


Figure D.7 Graphic presentation of control flow

## Example for Pseudocode Presentation of Controlflow

```
PROCEDURE H_0870_ zu Main ;
BEGIN
  Block 0870.a;
  IF 0870.b THEN BEGIN
    Block 0879.a;
    IF NOT 0879.b THEN BRANCH TO 0886 !!!;
    Block 087E;
  END
  ELSE BEGIN
x?:  Block 0886;
    WHILE 088D DO BEGIN
      Block 0892;
    END;
    Block 0898;
  END;

  RETURN ;
END;
```

If controlflow is not structured 100% pseudocode will involve jumps and the related labels. Jumps are marked by "!!!" labels by "?". Thus they may be easy found with an editor.

Figure D.8 Pseudocode presentation of control flow

### D.4 Data Flow Analyzer - DACAT

DACAT uses a file generated by DISCAT that identifies top level distributions of variables, and several files generated by COCAT that describe the control flow. From this it generates

- a statistical overview of variables usage (Figure D.9)
- a statistical overview of operand usage in a similar format
- a read/write table for each variable (Figure D.10)
- a pseudo code presentation of each routine with symbolic assignments (Figure D.11)



| Identifier | READ | WRIT | lo | glo | Mode | Identifier | READ | WRIT | lo | glo | Mode |
|------------|------|------|----|-----|------|------------|------|------|----|-----|------|
| b00        | 4    | 4    |    | 2   |      | b01        | 5    | 4    |    | 2   |      |
| b03        |      | 3    |    | 3   |      | b08        | 1    | 2    | X  |     |      |
| b09        | 1    | 2    | X  |     |      | b0C        | 2    | 2    |    | 3   |      |
| b0D        | 2    | 2    |    | 3   |      | b0E        | 2    | 2    |    | 3   |      |
| b0F        | 2    | 2    |    | 2   |      | b10        | 2    | 2    |    | 2   |      |
| b11        | 2    | 2    |    | 2   |      | b12        | 1    | 6    |    | 2   |      |
| b15        |      | 1    | X  |     |      | b16        | 9    | 9    |    | 2   |      |
| b17        | 1    | 6    |    | 2   |      | b18        |      | 1    | X  |     |      |
| b19        |      | 1    | X  |     |      | b1A        |      | 1    | X  |     |      |
| b1B        |      | 1    | X  |     |      | b1E        | 1    | 4    |    | 4   |      |
| b1F        | 1    | 4    |    | 4   |      | b8C        |      | 8    |    | 2   |      |
| b8E        |      | 7    |    | 2   |      | b90        |      | 4    |    | 2   |      |
| b91        |      | 4    |    | 2   |      | b92        |      | 3    |    | 2   |      |
| b93        |      | 2    |    | 2   |      | b94        | 2    |      |    | 2   |      |
| b95        | 4    |      |    | 2   |      | b96        |      | 7    | X  |     |      |
| b97        | 2    | 14   |    | 7   |      | bA9        |      | 7    |    | 2   |      |
| bAF        |      | 2    | X  |     |      | bB1        |      | 3    |    | 3   |      |
| bD3        |      | 5    |    | 4   |      | bD4        |      | 4    |    | 4   |      |
| bE0        | 3    |      |    | 2   |      | bE1        | 1    |      |    | X   |      |
| bE4        | 3    |      |    | 2   |      | bE6        | 1    |      |    | X   |      |
| bE7        | 9    | 3    |    | 5   |      | cy         | 16   | 97   |    | 14  |      |
| dptr       | 20   | 5    |    | 2   |      | p[#B0]     | 1    |      |    | X   |      |
| p[?]       | 20   |      |    | 2   |      | pc         | 3    |      |    | X   |      |
| r00        | 43   | 18   |    | 4   |      | r01        | 7    | 6    | X  |     |      |
| r02        | 8    | 3    |    | 2   |      | r03        | 12   | 6    | X  |     |      |
| r11        | 4    | 4    |    | 2   |      | r12        | 4    | 4    | X  |     |      |
| r14        | 5    | 2    | X  |     |      | r15        | 5    | 2    | X  |     |      |
| r16        | 3    | 2    | X  |     |      | r17        | 3    | 2    | X  |     |      |
| r1E        | 2    | 5    |    | 3   |      | r1F        | 2    | 5    |    | 3   |      |

Figure D.10 Variable usage

## Example for Pseudocode Presentation (File \*.PAS)

```
PROCEDURE H_0870_ zu Main ;
BEGIN
  Block 0870.a
  b97:=#0;
  rE0:=r45;
  cy:=§CYSUB(rE0,#00);
  IF (r45=#00) THEN BEGIN
    Block 0879.a
    rE0:=r44;
    cy:=§CYSUB(rE0,#00);
    IF NOT (r44=#00) THEN BRANCH TO 0886 !!!;
    Block 087E
    r46:=rE0;
    r47:=rE0;
    r48:=rE0;
  END
  ELSE BEGIN
    x7: Block 0886
    rE0:=#04;
    CALL 09B2;
    r46:=#7E;
    WHILE (bE7=#0) DO BEGIN
      Block 0892
      CALL 09B0;
      r46:=r46-#1;
    END;
    Block 0898
    cy:=§CYRRC(r46,#0);
    r46:=§RRC(r46,#0);
    rE0:=r44;
    bE7:=§CYRRC(r46,#0);
    r47:=r44;
    r48:=r45;
  END;
  RETURN;
END;
```

Figure D.11 Pseudocode Assignment Analysis

The statistical overviews can be used to determine adherence to provisions of the applicable coding standards, e. g., on the use of indirectly referenced variables. Another important use is to indicate the relative complexity of code segments, e. g., from the ratio of conditions to assignments, or the criticality of segments, e. g., by the number of global variable references. These inferences can guide the allocation of verification effort.

The read/write tables identify potential problem areas in the execution of the program, e. g., variables that are read but not written, or written but not read. Not all of these instances are programming errors, since the machine code does not distinguish between constants and variables, or between variables generated for use within the program and those generated for external use. But the identification provided by the table indicates where further analysis is required. The columns headed "lo" and "glo" in this figure denote local and global variables, respectively. The column headed "mode" permits designation of variables that can be accessed by bit-wise addressing.

The pseudo code is valuable as a starting point for further analysis required after examination of the previously discussed DACAT outputs. It can also be used as a backward reference to the source code.

#### D.5 Use of CATS for Analysis of a Real-Time Program

To aid in the understanding of CATS one module of a real-time program developed by SoHaR was submitted to TÜV Norddeutschland for analysis by CATS. The overall program involves multi-tasking and is intended to run on an 80286 or higher processor. The module submitted for analysis was separately compiled for an 80186 environment (and thus believed to be suitable for use with CATS) but the downgrading was not entirely successful and a number of 80286 instructions survived in the machine code that was analyzed. These instructions were recognized as anomalies and were the only outright deficiencies encountered in the analysis.

However, the CATS analysis also pointed to a number of weaknesses in the structure of the executable code that had gone unrecognized in the review of the source code:

- re-entrant code in library routines
- multiple entries to library routines
- multiple exits in compiled code (due to the optimizing feature of the compiler)
- use of nesting levels that were judged high by TÜV standards

After receipt of the results the implication of the weaknesses on the operation of the code were reviewed and it was decided that no changes were required. This does not detract from the value of identifying these potentially troublesome features. The most valuable function of the analysis



was the positive verification that the machine code corresponded essentially to the source code, and that it did not contain unspecified functions.

**BIBLIOGRAPHIC DATA SHEET**

(See instructions on the reverse)

1. REPORT NUMBER  
(Assigned by NRC. Add Vol., Supp., Rev.,  
and Addendum Numbers, if any.)

NUREG/CR-6293  
Vol. 2

2. TITLE AND SUBTITLE

Verification and Validation Guidelines for  
High Integrity Systems

Appendices A-D

3. DATE REPORT PUBLISHED

MONTH YEAR

March 1995

4. FIN OR GRANT NUMBER

12448

5. AUTHOR(S)

H. Hecht, M. Hecht, G. Dinsmore, S. Hecht, D. Tang

6. TYPE OF REPORT

Technical

7. PERIOD COVERED (Inclusive Dates)

8/27/92-12-31/93

8. PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)

SoHaR Incorporated  
8421 Wilshire Boulevard Ste 201  
Beverly Hills, CA 90211-3204

Under Contract to:  
Harris Corporation  
Information Systems  
P.O. Box 9800, Melbourne, FL 32902

9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same as above"; if contractor, provide NRC Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address.)

Division of Systems Technology  
Office of Nuclear Regulatory Research  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555-0001

10. SUPPLEMENTARY NOTES

11. ABSTRACT (200 words or less)

High integrity systems include all protective (safety and mitigation) systems for nuclear power plants, and also systems for which comparable reliability requirements exist in other fields, such as in the process industries, in air traffic control, and in patient monitoring and medical systems. Verification aims at determining that each stage in the software development completely and correctly implements requirements that were established in preceding phase, while validation determines that the overall performance of a computer system completely and correctly meets system requirements. Volume I of the report reviews existing classifications for high integrity systems and for the verification and validation procedures, based on assumptions about the environment in which these systems will be utilized. The final chapter of Volume I deals with a framework for standards in this field. Volume II contains appendices dealing with specific methodologies for system classification, for dependability evaluation, and for two software tools that can automate otherwise very labor intensive verification and validation activities.

12. KEY WORDS/DESCRIPTORS (List words or phrases that will assist researchers in locating the report.)

Verification  
Validation  
Computer System Integrity  
Software Test  
Software Reliability  
Error Classification

13. AVAILABILITY STATEMENT

Unlimited

14. SECURITY CLASSIFICATION

(This Page)

Unclassified

(This Report)

Unclassified

15. NUMBER OF PAGES

16. PRICE