


# End User Functional and Performance Requirements for HTGR Energy Supply to Industrial Processes

September 2010

The INL is a  
U.S. Department of Energy  
National Laboratory  
operated by  
Battelle Energy Alliance

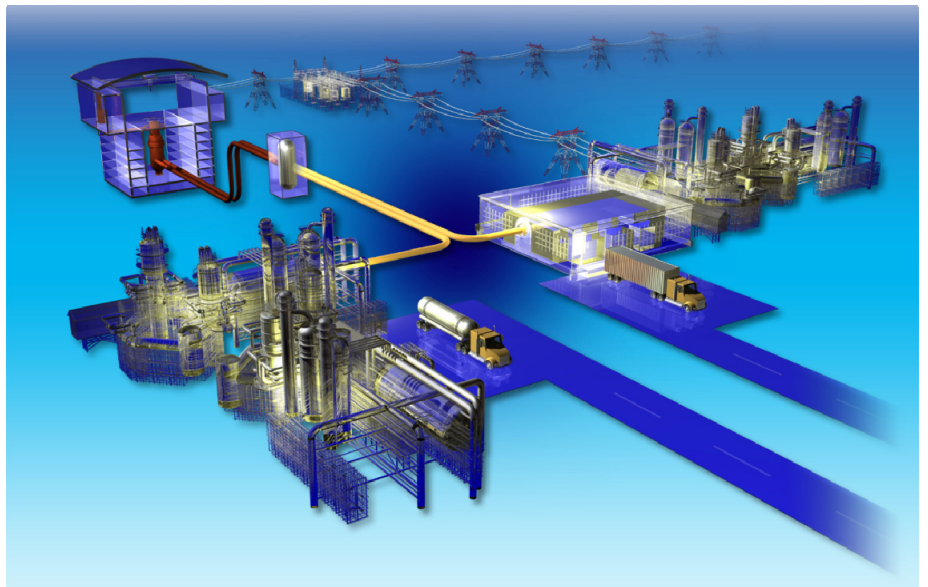

**DISCLAIMER**

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness, of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trade mark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

# **End User Functional and Performance Requirements for HTGR Energy Supply to Industrial Processes**

**September 2010**

**Idaho National Laboratory  
Next Generation Nuclear Plant Project  
Idaho Falls, Idaho 83415**

**Prepared for the  
U.S. Department of Energy  
Office of Nuclear Energy  
Under DOE Idaho Operations Office  
Contract DE-AC07-05ID14517**




Next Generation Nuclear Plant Project

**End User Functional and Performance Requirements**  
FOR **HTGR Energy Supply to Industrial Processes**

INL/EXT-10-19808

September 2010


Approved by:

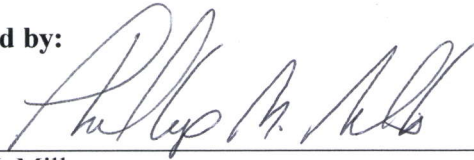

Phillip M. Mills  
NGNP Engineering Director (acting)

9/15/10

Date



Greg A. Gibbs  
NGNP Project Director

9/15/10

Date



## **ABSTRACT**

This document specifies end user functional and performance requirements to be used in the development of the design of a high temperature gas-cooled reactor (HTGR) based plant supplying energy to industrial processes. These requirements were developed from collaboration with industry and HTGR suppliers and from detailed evaluation of integration of the HTGR technology in industrial processes. The functional and performance requirements specified herein are an effective representation of the industrial sector energy needs and an effective basis for developing a plant design that will serve the broadest range of industrial applications.





# CONTENTS

ABSTRACT.....	v
1. INTRODUCTION.....	1
2. OBJECTIVE.....	2
3. ASSUMPTIONS.....	2
4. SCHEDULE.....	2
4.1 General.....	2
4.2 Plant Deployment Schedule and Information Requirements.....	2
5. ENERGY SUPPLY REQUIREMENTS.....	3
5.1 General.....	3
5.2 Industrial Processes.....	3
5.3 Steam Supply.....	4
5.3.1 Supply Requirements.....	4
5.3.2 Excess Demand.....	4
5.3.3 Interface Configurations.....	4
5.4 Electric Power Supply.....	6
5.4.1 Interface Configurations.....	6
5.4.2 Power Quality.....	6
5.5 High Temperature Gas Supply.....	6
5.5.1 General.....	6
5.5.2 Gas Supply Requirements.....	6
5.5.3 Gas Characteristics.....	7
5.5.4 Interface Configurations.....	7
5.6 Radionuclides.....	7
6. PERFORMANCE REQUIREMENTS.....	7
6.1 Normal and Emergency Demand Transients.....	7
6.1.1 Steam Headers.....	7
6.1.2 Electric Power.....	7
6.1.3 High Temperature Gas.....	8
6.1.4 Design Capabilities.....	8
6.1.5 Availability.....	8
6.2 Carbon Emissions.....	8
Appendix A—Results of End User Requirements Evaluations.....	9

## FIGURES

Figure 1. Functional and performance requirements development flow path.....	1
Figure A-1. Power conversion efficiency versus ROT.....	12
Figure A-2. Ammonia and ammonia derivatives production.....	14

Figure A-3. Coal to Gasoline Conversion using the MTG Process. .... 15

Figure A-4. Coal to Diesel Process. .... 16

Figure A-5. Use of the HTGR as an energy source in the Steam Methane Reforming Process. .... 17

Figure A-6. HTGR Integrated Steam Methane Reforming Process Performance versus ROT. .... 18

Figure A-7. HTSE Efficiency as a function of ROT. .... 19

**TABLES**

Table 1. Summary of ranges for energy supply characteristics. .... 4

Table A-1. Summary of evaluated power conversion system technologies. .... 12

Table A-2. Summary of identified end user needs. .... 20

# End User Functional and Performance Requirements for HTGR Energy Supply to Industrial Processes

## 1. INTRODUCTION

This document provides end user functional and performance requirements for application of the high temperature gas-cooled reactor (HTGR) technology for supply of energy to industrial processes. These requirements envelop the broad range of energy needs identified by the NGNP Project in collaboration with industrial potential end users and in assessments of the technical and economic viability of integrating the HTGR technology in industrial processes. These requirements apply to the nuclear heat supply system and the energy conversion system; the latter may comprise either or both a heat transport system and power conversion system. As shown in Figure 1, the requirements for the energy conversion system derive from the end user process requirements and at the interfaces inform the nuclear heat supply system requirements. In Figure 1 a hydrogen production system is shown in addition to a generic process requirements block. Although the hydrogen production system is a specific industrial process that places demands on the energy conversion system and ultimately the nuclear heat supply system, it is addressed separately herein to include the requirements that derive from the NGNP Project hydrogen production system development task.

A typical HTGR plant can be comprised of multiple identical reactor modules or multiple reactor modules of differing ratings and configurations that fulfill the requirements herein. These end user functional and performance requirements shall be used to establish the requirements and design characteristics of the Energy Conversion System and the Nuclear Heat Supply system.

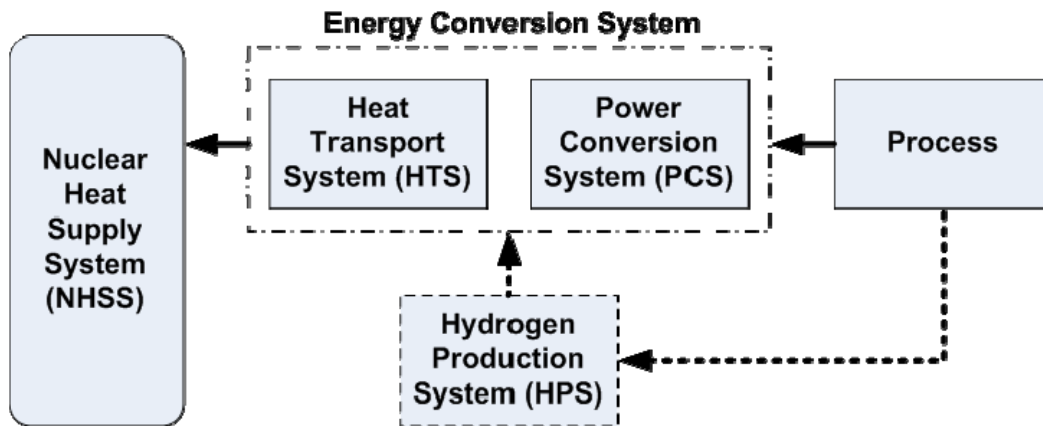


Figure 1. Functional and performance requirements development flow path.

These requirements represent a composite of information from discussions and detailed evaluations of energy needs jointly performed by INL and potential industrial end users. Appendix A summarizes the results of the evaluations performed to the time of this writing. These requirements will be updated as warranted as additional data is obtained.

For purposes of this document, the following definitions apply:

*End User* The entity whose Facility is being supplied the required energy in the forms specified and on whose property the HTGR energy supply is located

*Purchaser* The entity who purchases the energy from the Supplier, anticipated to occur via a long term energy purchase agreement

*Supplier* The entity who owns the HTGR energy supply

*Operator* The entity that is licensed to operate the HTGR energy supply

*Designer* The entity that performs the design of the HTGR energy supply and supports the licensing activities by the Operator

## **2. OBJECTIVE**

The objective of this document is to define end user requirements for an HTGR based energy supply system that meets the full range of energy needs of industrial processes evaluated to-date by the NGNP Project.

## **3. ASSUMPTIONS**

1. This specification does not include commercial issues.
2. The Purchaser of energy will enter into a contract with the Supplier for long term supply of energy.
3. The HTGR plant (hereinafter referred to as the “Plant”) will be operated by an entity other than the Purchaser
4. The Purchaser will support the Supplier in providing and developing data and information required to obtain a combined license for construction and operation of the HTGR energy source
5. The HTGR Plant will be sited within or adjacent to the Facility controlled area. The selected site for the Plant will depend on site surveys conducted to support licensing of the Plant by the USNRC. The HTGR energy supply plant site will be a separate facility within or adjacent to the Facility controlled area but will be under the control of the Plant Operator as required by the USNRC for an operating nuclear plant.

## **4. SCHEDULE**

### **4.1 General**

The HTGR Energy supply shall be fully operational no later than January 1, 20xx. The Supplier shall provide a schedule for a phased deployment, including the increments of energy supplied in each phase and the accumulated capacity, in accordance with the requirements below, assuming a Greenfield application.

### **4.2 Plant Deployment Schedule and Information Requirements**

The Supplier shall provide a detailed schedule for deployment of the HTGR energy supply. This schedule shall include as a minimum the following:

1. Development of the licensing strategy including requirements and timing for developing and submitting licensing documentation and applications
2. Plant Design

3. Plant Licensing Reviews
4. For each increment of energy supply:
  - a. Procurement
  - b. Site mobilization
  - c. Construction
  - d. Cold and Hot Testing
  - e. Initial Operation
  - f. Full Operation

The schedule shall be provided in [Primavera format, Version 6 or later at level 3].

## **5. ENERGY SUPPLY REQUIREMENTS**

### **5.1 General**

The HTGR plant design shall have the capability to supply energy to the industrial process in the following forms:

- Steam for general use throughout the facility
- Electricity to support facility operation and
- Process heat in the form of high temperature gas to selected plant processes to offset the emissions of greenhouse gases attendant to the burning of natural gas and waste gases in these processes

Since this plant is intended to be the primary source of energy to the facility, 100% availability is required.

The electrical distribution system within the facility shall include a cross-connection with the regional electrical grid in addition to the facility distribution system to permit flow of electricity to or from the regional grid.

Not all applications will require supply of all of these forms of energy; however, the fundamental plant design shall be capable of providing any mix of these forms as required by each specific application.

### **5.2 Industrial Processes**

At the time of this writing the NGNP Project has collaborated with industrial end users and performed several assessments of the technical and economic viability of integrating the HTGR technology with the industrial processes supplying the following:

- Steam, electricity and high temperature fluid (e.g., He, He-N, Air) for general facility use
- Steam for oil sands bitumen recovery. Supply of electricity to support facility operations and supply of hydrogen for upgrading the bitumen have also been identified as potential applications of the HTGR technology.
- Electricity using several different power conversion systems
- Hydrogen via high temperature steam electrolysis and steam methane reforming
- Ammonia and ammonia derivatives, (e.g., urea, ammonium nitrate, fertilizer)
- Coal and natural gas conversion to diesel fuel

- Coal and natural gas conversion to gasoline

Appendix A summarizes the results from evaluations of applying the HTGR technology in each of these industrial processes. Table 1 summarizes the range of energy supply characteristics identified in these evaluations

Table 1. Summary of ranges for energy supply characteristics.

<b>Reactor Outlet Temperature</b>	<b>Plant Rating</b>	<b>Supplied Steam Conditions</b>	<b>Electricity Requirements</b>	<b>High Temperature Fluid Conditions</b>
750 to 950°C	250 to 6,900 MWth	>4,000 psig for supercritical applications, 2,500 psig for subcritical applications 540 to 630°C	Up to 2,500 MWe investigated to-date. As a supply to the electrical grid a wide range is possible depending on the location.	700 to 925°C 54 to 762 MWth

## 5.3 Steam Supply

### 5.3.1 Supply Requirements

The HTGR plant shall be designed to supply steam to steam turbine generators and the header system of the facility. The HTGR steam supply shall interface with steam turbine generators within the HTGR plant and/or with steam headers at the HTGR plant boundary. The steam pressures and temperatures at those interfaces shall account for pressure and temperature drops along the header system to ensure that the pressures and temperatures at the end use meet requirements.

Based on work completed to the time of this writing steam pressure and temperature requirements can range from the supercritical, (e.g., to supply supercritical steam turbine generators) to very low pressures, (e.g., 30 psig to 40 psig at 50°F superheat).

The HTGR plant shall be designed to meet variations in steam demand from very low to maximum demand with demand characteristics as determined by the specific application and as specified in the sections below.

### 5.3.2 Excess Demand

Purchaser may exercise the option of increasing the steam demand for short periods of time. The notification and periods of increased demand shall be determined in the contract between the Supplier and the Purchaser.

### 5.3.3 Interface Configurations

The Designer shall coordinate with the Purchaser to define the specific configuration of the interfaces with the Facility steam headers. The following information shall be developed for each steam header as a minimum.

**5.3.3.1 Steam Supply Headers**

Header	Pipe Diameter, Inches	Schedule	Material	Insulation	Flange

**5.3.3.2 Over pressure protection**

Overpressure protection shall be provided by the Supplier at the steam source.

**5.3.3.3 Steam Chemistry**

Steam supplied to the steam headers shall meet the requirements of the ASME guideline “Consensus on Operating Practices for Control of Feedwater and Boiler Water Chemistry in Modern Industrial Boilers.”<sup>a</sup>

**5.3.3.4 Condensate Return**

The Purchaser shall return condensate to the HTGR plant at a rate equal to the full steam demand plus makeup as required by the HTGR plant.<sup>b</sup> This condensate shall be returned in a single header. The Designer and Purchaser shall establish the following for this header as a minimum.

Header	Pipe Diameter, Inches	Schedule	Material	Insulation	Flange

**5.3.3.5 Condensate Return and Makeup**

The Purchaser shall provide specifications for the makeup and condensate returned from the steam supplied to the headers including the following as a minimum:

- pH
- Conductivity
- TOC
- Oxygen
- Pressure
- Temperature

The Supplier shall provide any additional conditioning equipment required to meet the specification for feedwater or makeup water to the Plant.

---

a. Note that in some applications additional requirements for steam purity may also be mandated depending on the steam use (e.g. turbine driven compressors, etc.) in order to avoid unacceptable risk to component integrity or voiding of OEM warranties.

b. Makeup will be limited to the capacity of the Facility. Any required makeup in excess of the capacity of the Facility shall be provided by the Supplier.

### **5.3.3.6 Condensate and Steam Flow Metering**

The Supplier shall provide certified steam and condensate flow metering. Steam flow metering shall be pressure and temperature compensated.

## **5.4 Electric Power Supply**

The HTGR plant shall be designed to supply electricity to the facility. The electrical supply shall be designed to be compatible with the facility electrical distribution system and the regional grid.

### **5.4.1 Interface Configurations**

The Designer shall develop the configuration and design requirements for the electrical connection between the generator and low voltage taps on the facility distribution transformer and the regional grid transformer. The Supplier shall provide the transformers and power lines as required to connect with the facility distribution system and the regional grid.

### **5.4.2 Power Quality**

The frequency and other properties and characteristics, (e.g., phase voltage imbalance) shall be as required by the regional electricity supply utility for operation on its electrical system. Power factor correction will be provided by the Supplier. For conceptual design work, Designer shall use typical requirements for the U.S. grid. These include as a minimum:

Distribution Voltage, KV (Facility)  
(Regional Grid)

Phase

Frequency, hz (When islanded)

Power Factor

Facility Distribution Transformer, KVA

Regional Grid Transformer, KVA

## **5.5 High Temperature Gas Supply**

### **5.5.1 General**

The HTGR shall be designed to supply high temperature gas to selected processes in the facility according to the following:

- The high temperature gas supply circuit shall be isolated from the HTGR primary helium circuit.
- The working gas shall be compatible with the materials of construction in the gas circuit at all anticipated normal and abnormal operating conditions, (e.g., He, He-N<sub>2</sub>, Air)
- The working gas shall be compatible with standard circulator designs.
- A means to remove corrosion products and foreign objects shall be positioned in the gas circuit prior to entering the circulator

### **5.5.2 Gas Supply Requirements**

Based on the work completed to the date of this writing gas supply pressures and temperatures have been identified as required from the HTGR plant. Following are the high temperature gas supply requirements.



Gas Pressure at Header, psig	1000
Supply Temperature at Header, °C	700 to 925°C
Return Temperature at Header, °C	325 to 520°C

### 5.5.3 Gas Characteristics

The Designer shall provide suggested ranges for gas characteristics based on compatibility with HTGR energy supply design and materials of construction. The Designer and Purchaser shall determine the required gas chemistry conditions to satisfy both the HTGR plant and the process requirements to include as a minimum:

Oxygen	[upper and lower limits TBD]
Nitrogen	< [TBD] ppm
Moisture	[upper and lower dew point TBD]
Hydrogen	< [TBD] ppm
Carbon Dioxide	< [TBD] ppm

### 5.5.4 Interface Configurations

The interface headers shall be specified as follows:

Header	Pipe Diameter, Inches	Schedule	Material	Insulation	Flange
Supply					
Return					

## 5.6 Radionuclides

Detectable levels of radionuclides in the steam and gas supplied to the processes by the HTGR that could be transported from the primary helium circuit or activated by exposure to the primary helium circuit shall be de minimus; defined as not exceeding levels detected in the steam and gases used in these processes supplied from non-HTGR sources.

## 6. PERFORMANCE REQUIREMENTS

### 6.1 Normal and Emergency Demand Transients

The HTGR Plant shall be capable of responding to the following process transients without interruption or degradation of supply:

#### 6.1.1 Steam Headers

Step Change	±10%
Maximum rate of change	20% / min decreasing 20% / min increasing

#### 6.1.2 Electric Power

Step Change	±10%
Maximum rate of change	10 MW <sub>e</sub> /min decreasing 10 MW <sub>e</sub> /min increasing

### 6.1.3 High Temperature Gas

Step Change	$\pm 10\%$
Maximum rate of change	20%/min decreasing 20%/min increasing

### 6.1.4 Design Capabilities

1. Plant shall be capable of accepting a full load rejection from either steam, electrical or high temperature gas demand.
2. Plant shall be able to accept zero steam flow demand and/or zero power demand, and/or zero high temperature gas demand. If all demand is lost temporarily the HTGR plant shall remain capable of meeting demand as it is restored within a maximum time period to be supplied by the Designer.
6. Plant shall be capable of accommodating coincident average steam, electrical and high temperature gas demand.
7. Plant shall be capable of operating with zero condensate return from Purchaser for 2 full power days.

### 6.1.5 Availability

The average required supply of steam to the steam headers, high temperature gas to the gas headers and electrical power generation to the electrical interconnections shall be available 100% of the time (24 hours a day, 7 days a week, 365 (366 in leap years) days per year) with two of the nuclear heat supply modules out of service.

## 6.2 Carbon Emissions

The energy requirements summarized herein shall be achieved by the HTGR energy supply using solely nuclear heat.

## **Appendix A**

### **Results of End User Requirements Evaluations**



# Appendix A

## Results of End User Requirements Evaluations

The requirements summarized herein represent a composite of information from discussions and detailed evaluations of energy needs jointly performed by INL, the HTGR Suppliers and potential industrial end users. The following summarizes the results of the evaluations performed to the time of this writing. These will be updated as warranted as additional data is obtained.

### A-1. Steam Supply

The steam supply needs include steam turbine generators (STG) and steam supply headers supplying industrial facilities in a co-generation application, (e.g., typically in conjunction with electricity and high temperature gas supplies [INL2009]), and wells heads supporting steam assisted gravity drainage (SAGD) bitumen recovery in oil sands [TEV-704]. These uses include a wide range of steam pressures, temperatures and demands as follows.

Rankine STG –	2500 psig, 540°C to 593°C
Supercritical STG	3500 psig to 4500 psig, 565°C to 630°C
Process steam demands	Several pressures from 2500 psig to 30 psig at temperatures ranging from saturation and up to several hundred°C superheat, typically extracted from sub critical stages of a steam turbine generator

The steam demands cover a very wide range depending on the facility.

Oil sands bitumen recovery – 2,500 psig, 540°C at the HTGR; sufficient to produce secondary steam at 1500 psig, 310°C for injection into the wells. A 600 MWt HTGR based plant can support recovery of 56,000 barrels per day of bitumen

### A-2. Electricity Supply to the Grid

Over a ROT range of 750°C to 950°C a potential net efficiency range of 40% to 48% has been estimated, see Figure A-1. The likely applications of an HTGR electrical supply to the grid would be in an area with minimum water supply and/or limited transmission and distribution capacity that could not support a larger plant.

Different power conversion technologies are needed to take advantage of the higher ROT to achieve these net efficiencies. At the lower temperatures (<800°C ROT) the Rankine steam turbine generator cycle applies. Above 800°C direct Brayton, indirect Brayton combined cycle and supercritical CO<sub>2</sub> technologies have been assessed.

The power conversion technologies investigated by the NNGP Project include those listed in Table A-1. [TEV-674, TEV-981]

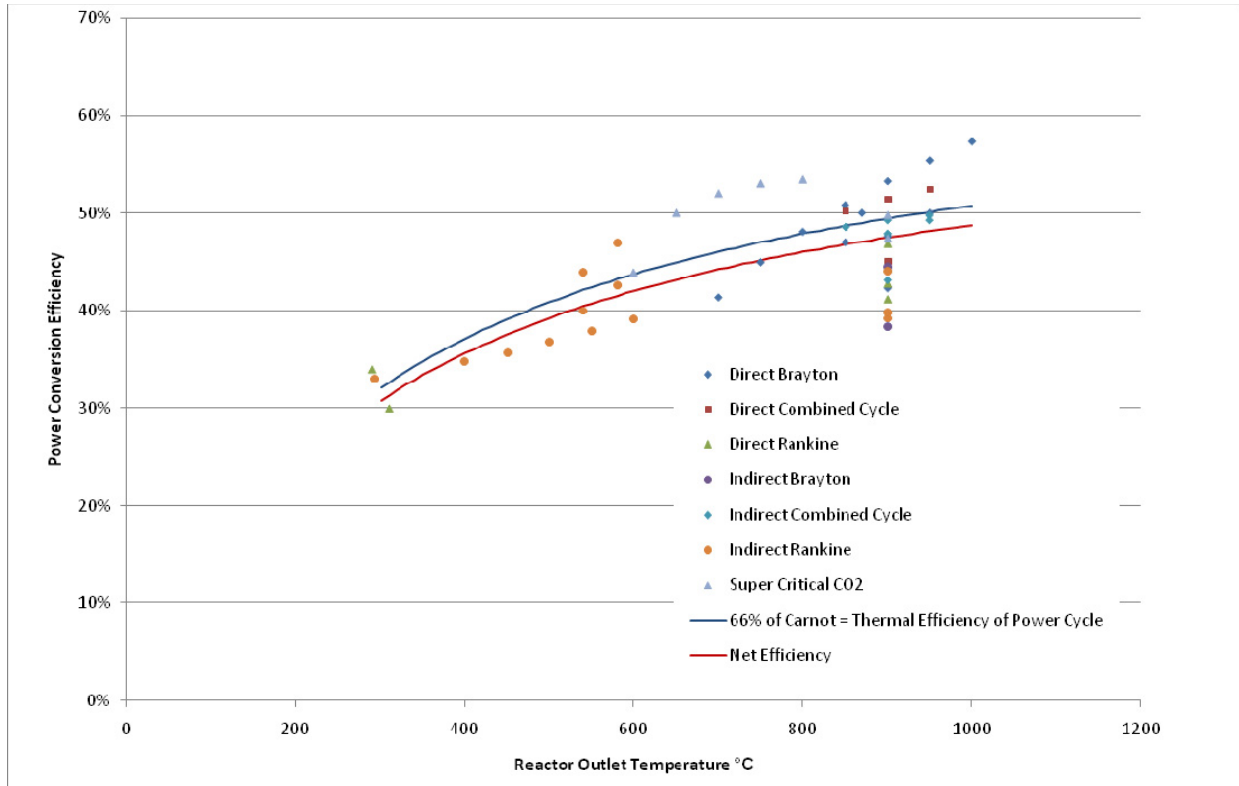


Figure A-1. Power conversion efficiency versus ROT.

Table A-1. Summary of evaluated power conversion system technologies.

PCS Technology	Fluid	Required Supply Temp.	Net Efficiency	Comment
Rankine Steam Turbine Generator	Subcritical steam	540 to 590°C	40 to 43%	Current state-of-the-art applying typical coal fired plant steam conditions.
Supercritical Steam Turbine Generator	Supercritical steam	565 to 630°C	43 to 45%	Provides higher net efficiencies. Advances have been made in materials permitting the use of these conditions.
Direct Brayton Gas Turbine Generator <sup>a</sup>	Primary circuit helium	850 to 950°C	47 to 55%	This technology is in development via a collaboration between the US and Russia.
Indirect Brayton Combined Cycle Generator <sup>b</sup>	Secondary circuit gas	900 to 925°C	38 to 45%	The turbine section of this technology is highly developmental. The subcritical section would apply well known technology used in natural gas fired combined cycle units.
Supercritical CO <sub>2</sub> Generator	Secondary circuit CO <sub>2</sub>	600 to 800°C	44 to 53%	Highly developmental including the need for a helium to CO <sub>2</sub> intermediate heat exchanger. This could provide a significant efficiency improvement and smaller PCS footprint.

a. The “Direct” notation refers to use of primary helium in the Brayton cycle.

b. The “Indirect” notation refers to a configuration that includes an intermediate heat exchanger between the primary helium circuit and a secondary gas circuit. The secondary gas circuit includes the Brayton cycle gas turbine.

### A-3. Electricity supply to an industrial facility

The power conversion technologies summarized in Table A-1 could be applied to supply electricity to an industrial facility. The selection of the technology should be coordinated with other energy needs. If a significant steam supply at medium to low pressure ranges is required, (e.g., for a typical petro-chemical plant) a supercritical or Rankine steam turbine generator with appropriate extractions may be preferred. If the electricity requirements dominate the energy requirements, (e.g., supplying a high temperature steam electrolysis hydrogen production facility) a higher temperature and higher net efficiency electrical generator may be favored with a smaller heat recovery or other steam generation facility. These selections will typically be driven by economics.

### A-4. High Temperature Fluids

To the date of this writing helium, helium-nitrogen and air have been assessed for use in the secondary circuit for transport of high temperatures from the nuclear heat supply system through an intermediate heat exchanger to the process. Specific applications that require high temperature fluid include:

- Indirect Brayton combined cycle power conversion system as identified above.
- Supply to selected industrial plant processes as a substitute for burning natural gas and waste gases

The specific conditions required to support some of the industrial plant processes that have been evaluated for use of the HTGR energy source are proprietary to the end user. In general these have gas temperature requirements in the 800°C to 950°C range with ratings in the 200 MW<sub>t</sub> to 400 MW<sub>t</sub> range. There are several other processes that have been evaluated by the NGNP Project on a generic basis, (e.g., in comparison with conventional processes). The energy requirements for integration of the HTGR energy source with these processes are summarized in the following.

- Supply of heat to the primary reformer and electricity for ammonia and ammonia derivative production

The NGNP Project evaluated the use of the HTGR as an energy supply for ammonia and ammonia derivatives production. [TEV-666] Temperatures in the range  $\geq 350^{\circ}\text{C}$  to 700°C for natural gas pre-heating and replacing natural gas in the primary reformer have been evaluated. Higher temperatures could be applied in the primary reformer to improve efficiency. Higher ROT could eliminate the reforming stage which utilizes fuel gas combustion. A further reduction in the natural gas feed requirement could be achieved by developing a modification that separates the purge gas from the ammonia synthesis loop. The benefit of these changes has not been quantified at the time of this writing.

The evaluations performed by the NGNP Project investigated the energy requirements for a plant with the following capacities:

Ammonia	3,360 tons/day
Nitric acid	5,190 tons/day
Urea	2.940 tons/day
Ammonium Nitrate	3780 tons/day

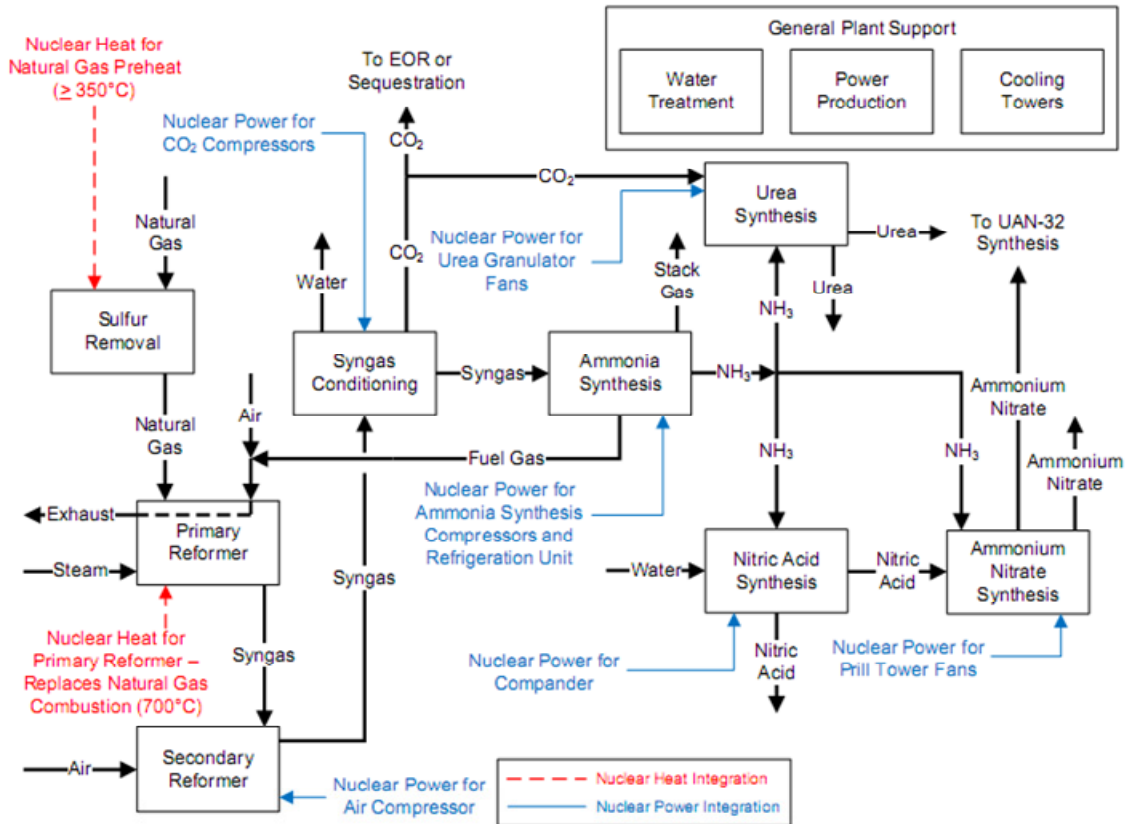


Figure A-2. Ammonia and ammonia derivatives production.

The energy requirements for the plant shown in Figure A-2 include 106 MW<sub>e</sub> electricity and 190 MW<sub>t</sub> of process heat.

The NGNP Project also evaluated ammonia production using high temperature steam electrolysis (HTSE) supported by the HTGR plant to provide high purity hydrogen directly to the ammonia synthesizer along with nitrogen from combustion or from an air separation unit. The production rates were the same as listed above except that the HTSE plant also produces oxygen at a rate of ~2,500 tons day. The energy requirements for those applications include 770 MW<sub>e</sub> to 879 MW<sub>e</sub> electrical power and 222 MW<sub>t</sub> to 262 MW<sub>t</sub> process heat.

- Supply of process heat for coal or natural gas to gasoline using the methanol to gasoline process.

The NGNP Project assessed the integration of the HTGR with processes for converting coal and natural gas to gasoline using the methanol to gasoline (MTG) process. [TEV-667] Figure A-3 shows this integration using the HTSE hydrogen production process and coal as the feedstock. This process converts ~98 % of the carbon in the coal to ~58,000 bpd of gasoline and ~9,100 bpd of Liquefied Petroleum Gas. This compares with a conversion rate of ~45% for a conventional coal to MTG process. The energy requirements of the HTGR are ~2,500 MW<sub>e</sub> electrical power, primarily to the HTSE plant and 706 MW<sub>t</sub> of process heat at up to 850°C to the HTSE plant.



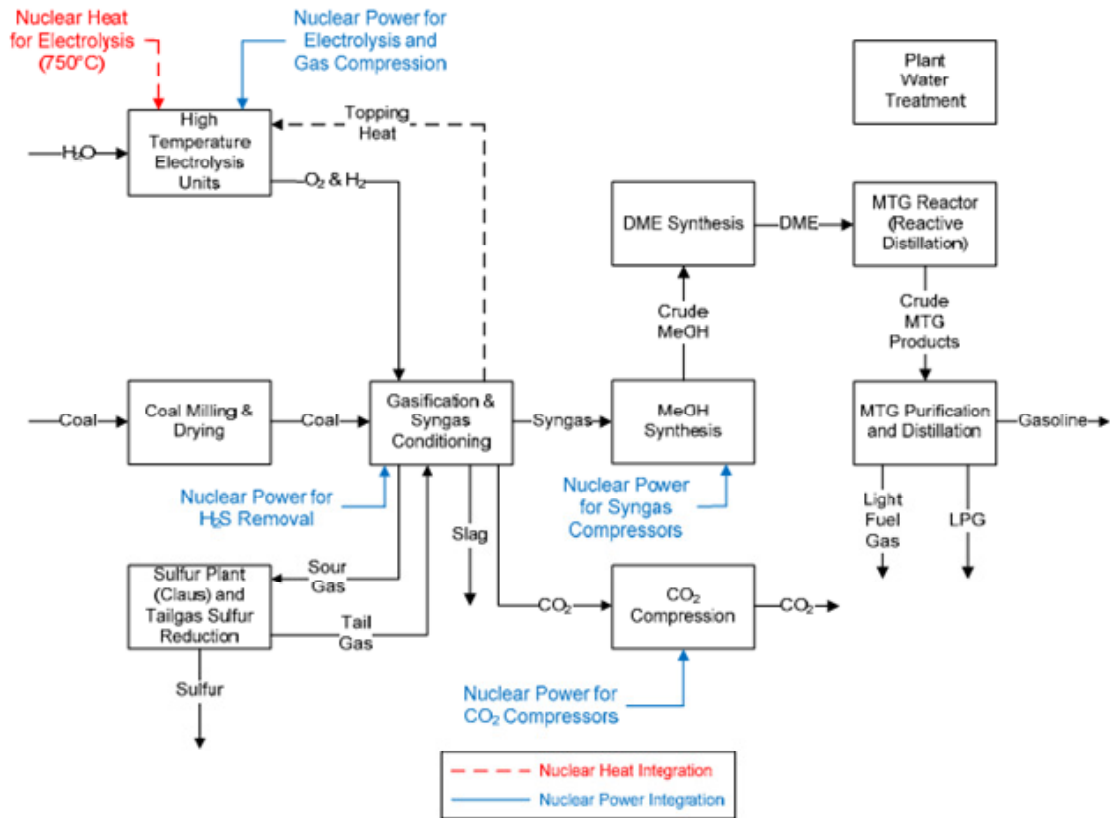


Figure A-3. Coal to Gasoline Conversion using the MTG Process.

The natural gas to gasoline plant size is smaller; 33,000 bpd of gasoline. For this assessment the HTGR plant was assumed to supply process heat to the primary reformer at 700°C. Supply of process heat to the reformer at higher temperature, (e.g., up to 900°C) would improve process efficiency.

- Supply of process heat for coal or natural gas to diesel

The NGNP Project evaluated the use of the HTGR to support conversion of coal and natural gas to diesel fuel in comparison with conventional processes. [TEV-672] Figure A-4 shows the integration of the HTGR with the high temperature steam electrolysis process for the conversion of coal to diesel, naphtha and liquefied petroleum gas (LPG). This process results in ~95% carbon conversion to fuel versus the ~35% conversion of a conventional process.

The process evaluated produced:

Diesel	35,000 bpd
Naphtha	12,000 bpd
LPG	3,000 bpd

The energy requirements for this process include 2,324 MW<sub>e</sub> of electricity and 762 MW<sub>t</sub> of process heat at up to 850°C. All of this energy supplies the HTSE plant.

The NGNP Project evaluation included a gas to liquids plant with the same output as that for the HTSE supported plant. This plant uses HTGR process heat for preheat of the combined natural gas feed and light gas recycle stream for hydrotreating, sulfur removal, pre-forming, and autothermal reforming. In addition, HTGR process heat is utilized to provide heat to the reboilers in the product upgrading and refining area. 588 MW<sub>t</sub> of process heat is supplied by the HTGR for these processes.

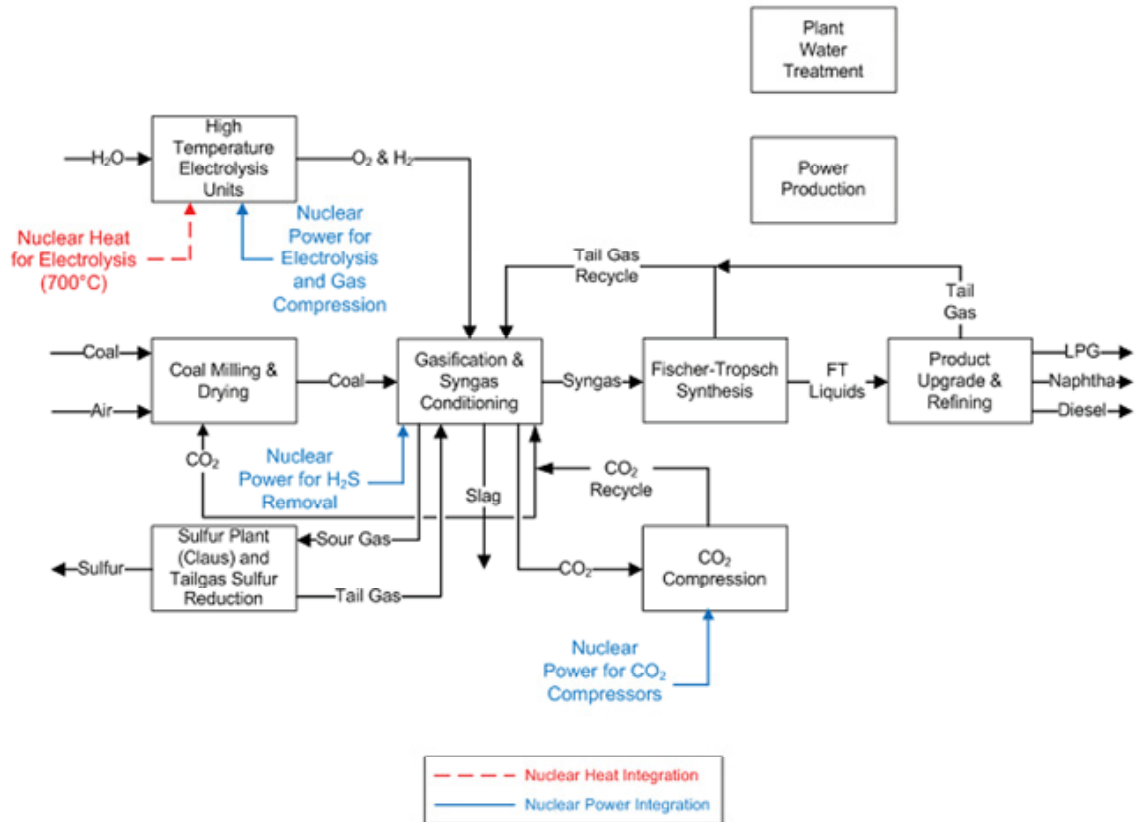


Figure A-4. Coal to Diesel Process.

- Hydrogen production

As noted in the preceding discussion many of the processes evaluated by the NGNP Project require hydrogen. In addition the Project identified merchant hydrogen supply as a potential market for HTGR technology. Accordingly, the NGNP Project has evaluated the application of the HTGR technology in support of two hydrogen production processes; the traditional steam methane reforming process and the high temperature steam electrolysis process.

- Hydrogen production using the HTGR as a heat source in the steam methane reforming process  
 The NGNP Project investigated the effect of varying ROT on the effectiveness of applying the HTGR process heat to the steam methane reforming process as shown in Figure A-5. [TEV – 962] The HTGR is used as a substitute for natural gas firing in the steam reformer. Depending on the gas temperature from the HTGR it can supply a fraction or all of the heat required in the reformer. Below an ROT of 925°C some natural gas is burned to augment the HTGR process heat. Above 925°C ROT the process heat from the HTGR is sufficient.

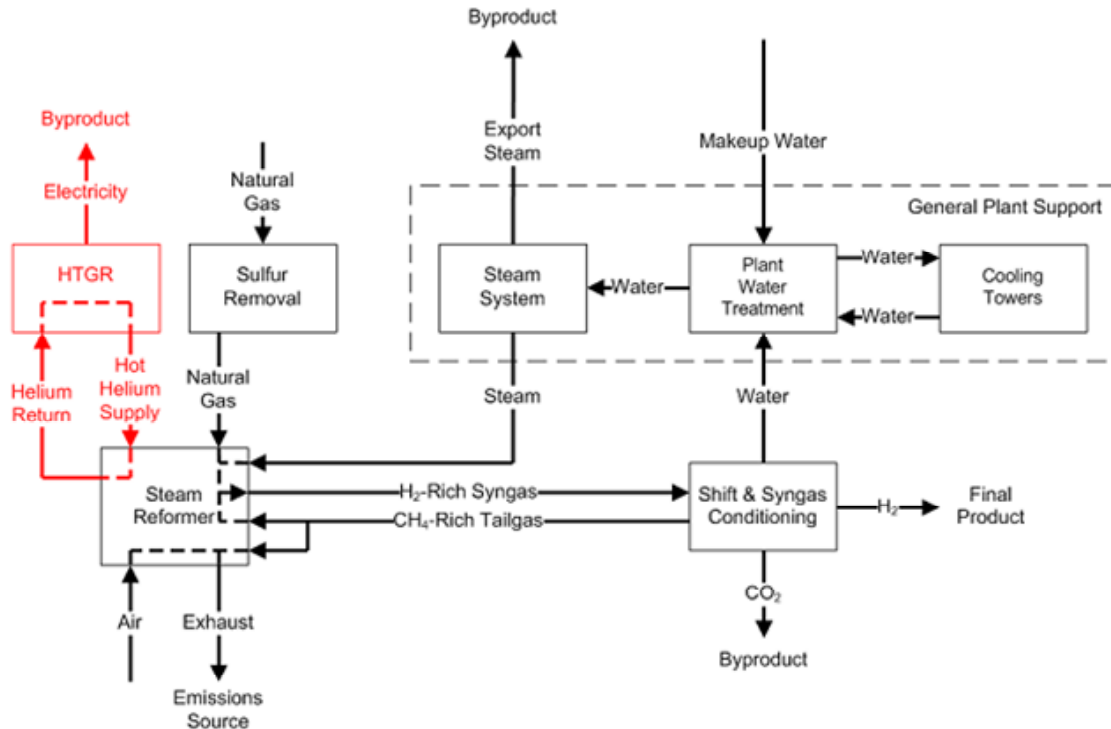


Figure A-5. Use of the HTGR as an energy source in the Steam Methane Reforming Process.

Figure A-6 shows the effect of ROT on the performance of the hydrogen process. An optimal ROT of around 875°C was identified for the reforming scenario analyzed. Note that this process generates significant amounts of steam that can be used in other parts of the facility, (e.g., for running steam turbines driving large compressors).

This analysis investigated the effect of ROTs in the range 725°C to 950°C on the process performance. The analysis assumed a single hydrogen production train producing 130 MMSCFD of hydrogen and between 176 to 54 MMBtu/hour of steam. The amount of steam produced reduces as the ROT increases toward 875°C because of the lower amounts of natural gas burned in the process. Depending on the ROT between 117 MW<sub>t</sub> to 177 MW<sub>t</sub> of process heat and 14 MW<sub>e</sub> to 17 MW<sub>e</sub> of electricity are required from the HTGR plant. This would require a HTGR nuclear heat supply rating of about 250 MW<sub>t</sub>. A multiple train system or integrating this energy demand in with other energy demands improves the economics of this application.

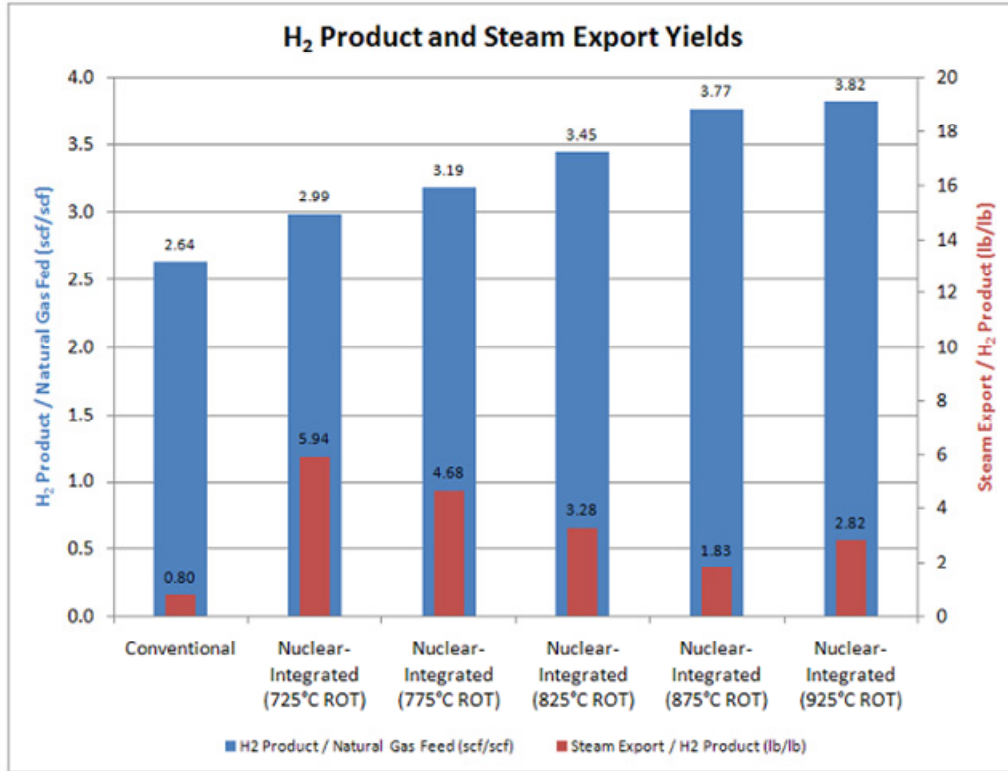


Figure A-6. HTGR Integrated Steam Methane Reforming Process Performance versus ROT.

- Hydrogen Production using high temperature steam electrolysis

The NGNP Project is tasked with development of the high temperature steam electrolysis (HTSE) hydrogen production system. The majority of the energy needs of the HTSE system is electricity; however, high temperature heat is required for steam generation in the electrolyzers. The efficiency and, therefore, the throughput of the process as a function of energy input is a strong function of the ROT. This is illustrated in Figure A-7 that shows that the efficiency of the process as a function of ROT. [TEV-981] As shown the higher the ROT the higher the efficiency. The study supporting this chart applied a 600 MW<sub>t</sub> HTGR supplying process heat and electricity. For ROTs less than 800°C natural gas supplemental firing was used to optimize the performance of the electrolyzers. That explains the shift in the curve of Figure A-7 above an ROT of 800°C. Production rates for the plant varied from 1.9 kg/sec to 2.12 kg/sec depending on the ROT and whether a steam or air sweep was employed. The detailed results of these analyses are summarized in Table A-2.

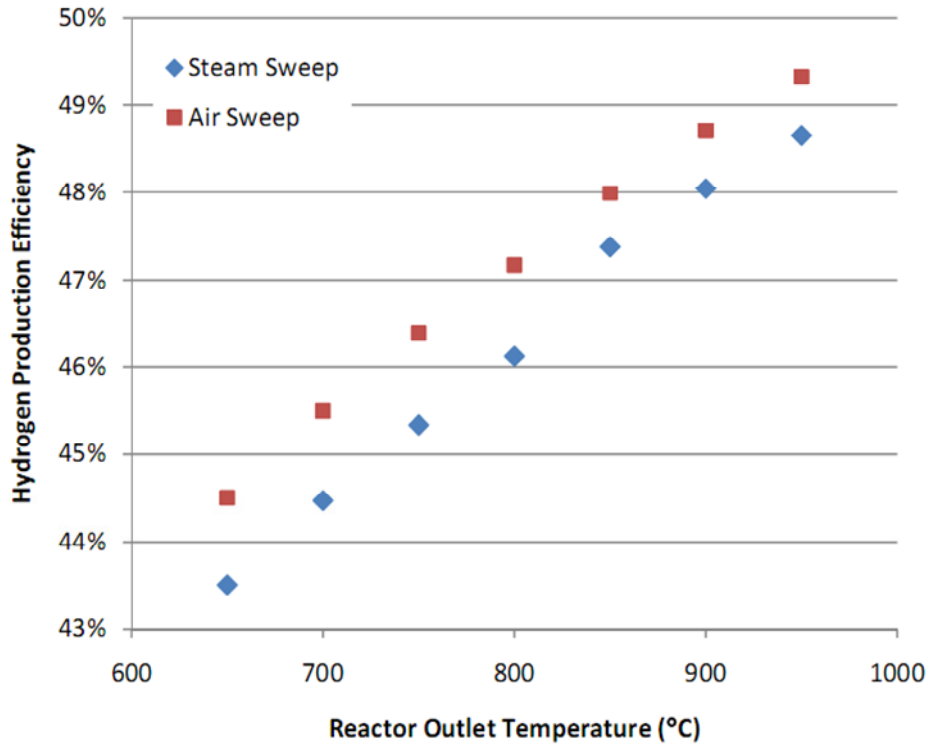


Figure A-7. HTSE Efficiency as a function of ROT.

A compilation of the characteristics of the energy required to support these processes and supply these products is summarized in Table A-2.

Table A-2. Summary of identified end user needs.

Process	Reactor Outlet Temperature	Plant Rating	Steam Conditions	Electricity Requirements	High Temperature Fluid Conditions	Production	Comment
Cogeneration	750 to 950°C	600 to 2400 MWth	3500 to 4500 psig, 565 to 630°C 2500 to 30 psig, 540°C to saturation	240 to 500 MWe	800 to 900°C 200 to 400 MWth	Steam, Electricity and High Temperature Fluids over wide ranges	The range of requirements varies considerably depending on the size of the facility and the processes involved.
Recovery of bitumen from oil sands	750°C	600 MWth	2500 psig, 540°C at the HTGR Secondary system, 1500 psig, 310°C at the well heads	Not evaluated to-date. Electricity could be generated in the HTGR plant to support oil sands operations.	Not evaluated to-date Process heat would be used in conjunction with electricity to produce hydrogen for upgrading the bitumen for transfer to the refinery	56,000 barrels per day of bitumen	This plant would be sufficient to provide required energy to a 3-pad facility with 12 well pairs per pad with a nominal 5 km distance from the centralized steam supply to the wells. Multiple units could be provided to supply the energy to support more wells, supply electricity and supply hydrogen to a major upgrading facility.
Electricity Production	750 to 950°C	Variable	Variable	Power conversion efficiencies vary from 40 to 49% depending on the technology	750°C to support Rankine Cycle 900 to 950°C to support Brayton Cycle [TBD] to support supercritical CO <sub>2</sub> cycle	Variable	PCS technologies being investigated include Rankine and supercritical steam turbine generators, direct Brayton cycle, indirect Brayton combined cycle, supercritical CO <sub>2</sub> .
Ammonia and derivatives using HTGR process heat in primary reformer	750°C as a minimum	450 MWth	N/A	106 MWe	> 350 to 700°C 190 MWth	Ammonia 3,360 tpd Nitric Acid – 5,190 tpd Urea – 2,940 tpd Ammonium Nitrate – 3,780 tpd	Process efficiency can be improved with a higher ROT

Process	Reactor Outlet Temperature	Plant Rating	Steam Conditions	Electricity Requirements	High Temperature Fluid Conditions	Production	Comment
Ammonia and derivatives using HTSE	750 to 900°C	2,500 MWth	N/A	770 to 880 MWe	700 to 875°C	Same as preceding with ~2,500 tpd of oxygen added	The higher ROT is required to provide the best process efficiency
Coal to Gasoline Conversion using the MTG process	750 to 950°C	6,900 MWth	N/A	2,500 MWe	700 to 900°C 706 MWth	Gasoline – 58,000 BPD LPG – 9,100 BPD	The higher ROT temperature improves the overall efficiency of the process
Natural Gas to Gasoline using the MTG Process	750°C minimum	720 MWth	N/A	115 MWe	700°C 387 MWth	Gasoline – 33,500 BPD 5,300 BPD LPG	Higher ROT would improve the reforming efficiency
Coal to Synthetic Diesel Conversion	750 to 950°C	6,571 MWth	N/A	2,324 MWe	700 to 900°C 762 MWth	Diesel -- 35,000 BPD Naphtha – 12,000 BPD LPG – 3,000 BPD	To be economic compared with conventional crude refining and coal to liquid processes the ROT needs to be as high as achievable.
Natural gas to diesel conversion	750°C	600 MWth	N/A	N/A	750°C 588 MWth	Same as preceding	In this case a higher ROT does not improve the process results. Autothermal reforming is used, instead of traditional steam methane reforming. Therefore, the HTGR heat is only used for preheat.
Hydrogen using HTGR process heat in Steam Methane Reformer	725 to 925°C	250 MWth	N/A	14 MWe to 17 MWe	700°C to 900°C	Hydrogen – 130 MMSCFD Steam – 176 to 54 MMBtu/hour	The throughput and economic viability of this application peak at an ROT of ~875°C. Multiple production trains improve economics. Steam production reduces as the ROT is increased.
Hydrogen	650°C	600 MWth	N/A	239 MWe	625 C @ 7 MPa, 54 MWth	1.94 kg/s	The efficiency of the process increases with increasing

<b>Process</b>	<b>Reactor Outlet Temperature</b>	<b>Plant Rating</b>	<b>Steam Conditions</b>	<b>Electricity Requirements</b>	<b>High Temperature Fluid Conditions</b>	<b>Production</b>	<b>Comment</b>
Using HTSE	700°C	600 MWth	N/A	244 MWe	675 C @ 7 MPa, 56 MWth	1.98 kg/s	ROT.
	750°C	600 MWth	N/A	248 MWe	725 C @ 7 MPa, 58 MWth	2.02 kg/s	
	800°C	600 MWth	N/A	252 MWe	775 C @ 7 MPa, 59 MWth	2.05 kg/s	
	850°C	600 MWth	N/A	255 MWe	825 C @ 7 MPa, 62 MWth	2.07 kg/s	
	900°C	600 MWth	N/A	258 MWe	875 C @ 7 MPa, 64 MWth	2.10 kg/s	
	950°C	600 MWth	N/A	261 MWe	925 C @ 7 MPa, 65 MWth	2.12 kg/s	



## A-5. References

- INL 2009 INL/LTD-09-17394, Evaluating Use of HTGR Technology as an Energy Supply for Petrochemical Facilities, September 24, 2009
- TEV-666 Nuclear-Integrated Ammonia Production Analysis, Rev 2, 5/25/10
- TEV-667 Nuclear-Integrated Methanol-to Gasoline Production Analysis, Rev 1, 5/15/10
- TEV-672 Nuclear-Integrated Coal and Gas to Liquids Production Analysis, Rev 1, 5/15/10
- TEV-674 Power Cycles for the Generation of Electricity from a Next Generation Nuclear Plant, Rev 1, 2/11/10
- TEV-704 Nuclear Assisted Oil Sands Recovery via Steam-Assisted Gravity Drainage, Rev 1, 2/22/10
- TEV-962 Sensitivity of Hydrogen Production via Steam Methane Reforming (SMR) to High Temperature Gas Reactor (HTGR) Reactor Outlet Temperature (ROT) Economic Analysis, 8/31/10
- TEV-981 An Analysis of the Effect of Reactor Outlet Temperature of a High Temperature Reactor on Electric Power Generation, Hydrogen Production, and Process Heat, Draft, 8/31/10